

# ***Operations Performance Metrics Monthly Report***



## ***November 2017 Report***

### **Operations & Reliability Department New York Independent System Operator**

Prepared by NYISO Operations Analysis and Services, based on settlements initial process data collected on or before December 2, 2017.

## **Table of Contents**

- ◆ **Highlights**
  - *Operations Performance*
  
- ◆ **Reliability Performance Metrics**
  - *Alert State Declarations*
  - *Major Emergency State Declarations*
  - *IROL Exceedance Times*
  - *Balancing Area Control Performance*
  - *Reserve Activations*
  - *Disturbance Recovery Times*
  - *Load Forecasting Performance*
  - *Wind Forecasting Performance*
  - *Wind Performance and Curtailments*
  - *Lake Erie Circulation and ISO Schedules*
  
- ◆ **Broader Regional Market Performance Metrics**
  - *PAR Interconnection Congestion Coordination Monthly Value*
  - *PAR Interconnection Congestion Coordination Daily Value*
  - *Regional Generation Congestion Coordination Monthly Value*
  - *Regional Generation Congestion Coordination Daily Value*
  - *Regional RT Scheduling - PJM Monthly Value*
  - *Regional RT Scheduling - PJM Daily Value*
  
- ◆ **Market Performance Metrics**
  - *Monthly Statewide Uplift Components and Rate*
  - *RTM Congestion Residuals Monthly Trend*
  - *RTM Congestion Residuals Daily Costs*
  - *RTM Congestion Residuals Event Summary*
  - *RTM Congestion Residuals Cost Categories*
  - *DAM Congestion Residuals Monthly Trend*
  - *DAM Congestion Residuals Daily Costs*
  - *DAM Congestion Residuals Cost Categories*
  - *NYCA Unit Uplift Components Monthly Trend*
  - *NYCA Unit Uplift Components Daily Costs*
  - *Local Reliability Costs Monthly Trend & Commitment Hours*
  - *TCC Monthly Clearing Price with DAM Congestion*
  - *ICAP Spot Market Clearing Price*
  - *UCAP Awards*

## November 2017 Operations Performance Highlights

- Peak load of 20,712 MW occurred on 11/10/2017 HB 17
- All-time winter capability period peak load of 25,738 MW occurred on 1/7/2014 HB 18
- 0 hours of Thunder Storm Alerts were declared
- 0 hours of NERC TLR level 3 curtailment
- Solar forecasting was activated November 2.
- The following table identifies the estimated production cost savings associated with the Broader Regional Market initiatives.



	Current Month Value (\$M)	Year-to-Date Value (\$M)
<b>NY Savings from PJM-NY Congestion Coordination</b>	\$0.85	\$10.50
<b>NY Savings from PJM-NY Coordinated Transaction Scheduling</b>	(\$0.03)	(\$1.13)
<b>NY Savings from NE-NY Coordinated Transaction Scheduling</b>	(\$0.21)	(\$1.17)
<b>Total NY Savings</b>	\$0.61	\$8.20
<b>Regional Savings from PJM-NY Coordinated Transaction Scheduling</b>	\$0.22	\$2.83
<b>Regional Savings from NE-NY Coordinated Transaction Scheduling</b>	\$0.03	\$1.03
<b>Total Regional Savings</b>	\$0.25	\$3.86



- The following table identifies the Monthly ICAP Spot Market prices and the price delta.

Spot Auction Price Results	NYCA	Lower Hudson Valley Zones	New York City Zone	Long Island Zone
December 2017 Spot Price	\$0.25	\$3.38	\$3.38	\$0.68
November 2017 Spot Price	\$0.25	\$3.47	\$3.47	\$0.90
Delta	\$0.00	(\$0.09)	(\$0.09)	(\$0.22)


- LI - Price decrease by \$0.22 due to decrease in unoffered capacity and increase in SCRs

## Reliability Performance Metrics

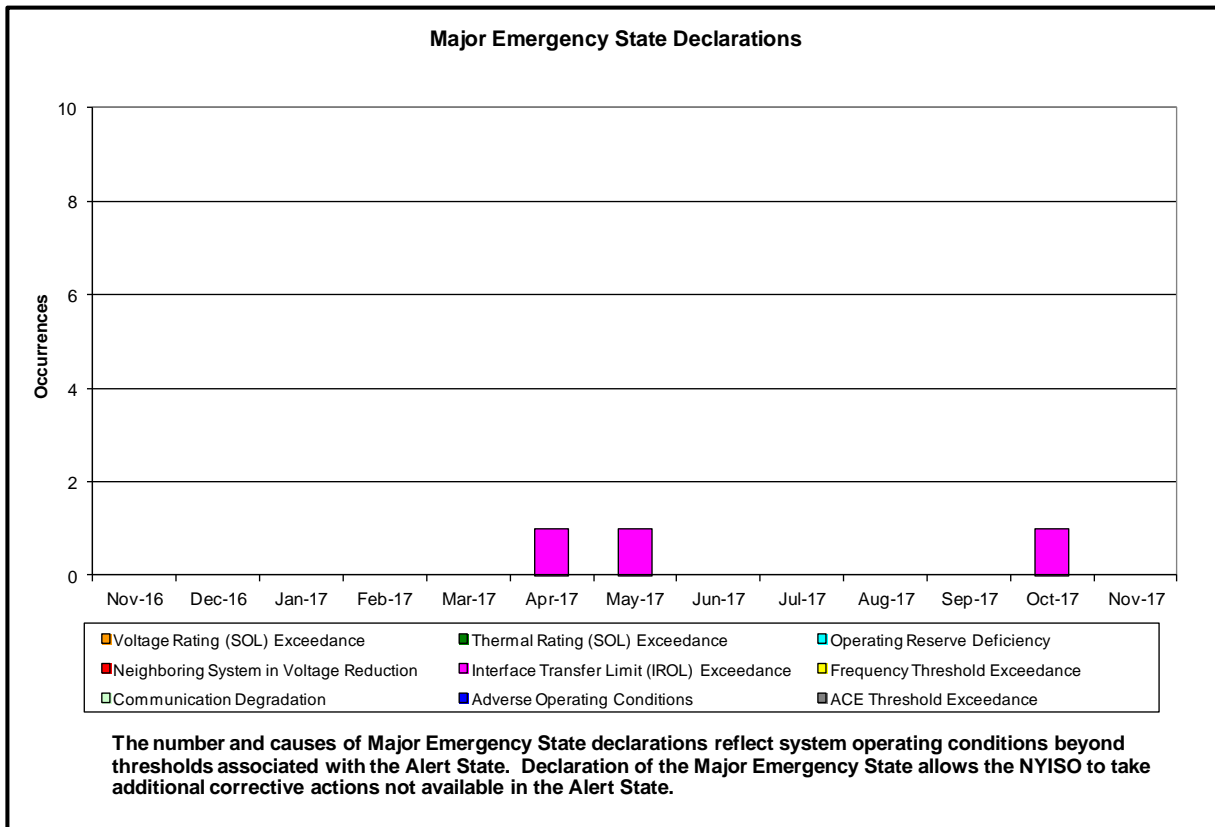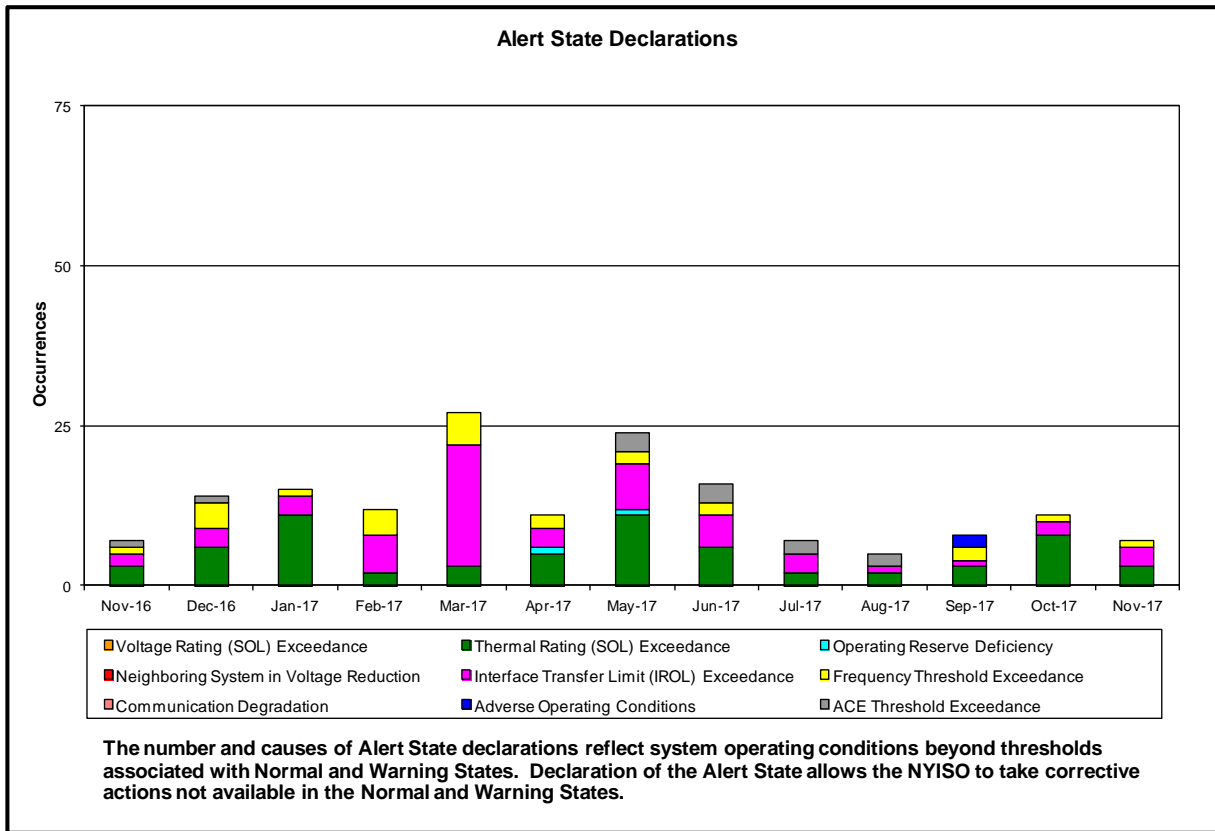

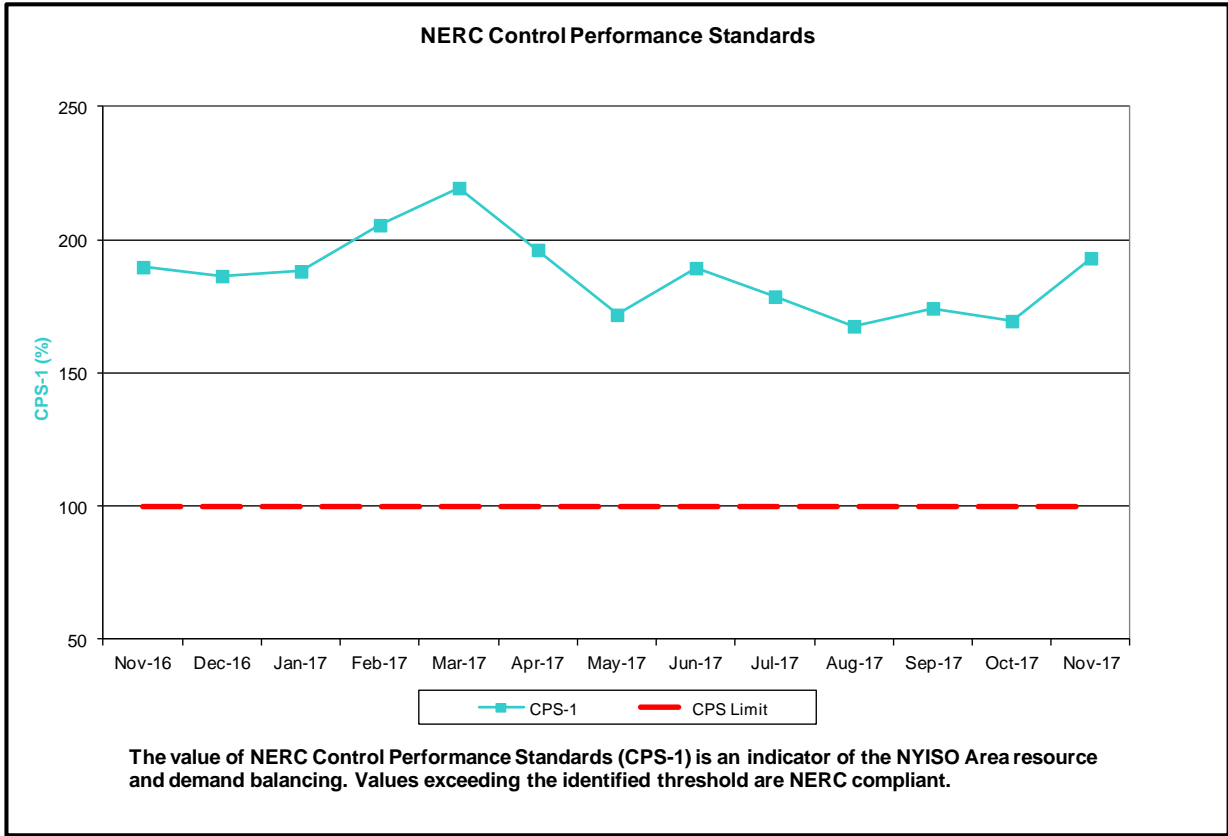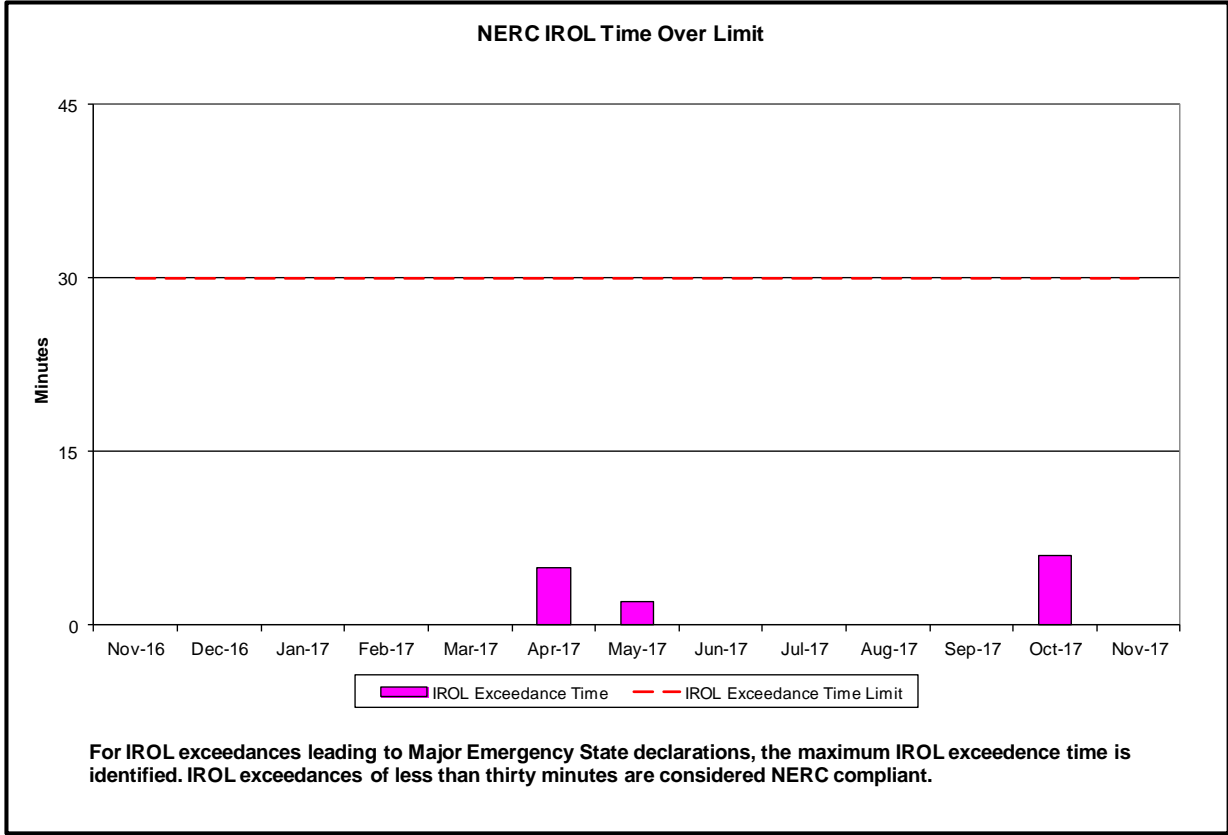


### NERC Balancing Authority ACE Limit Standard

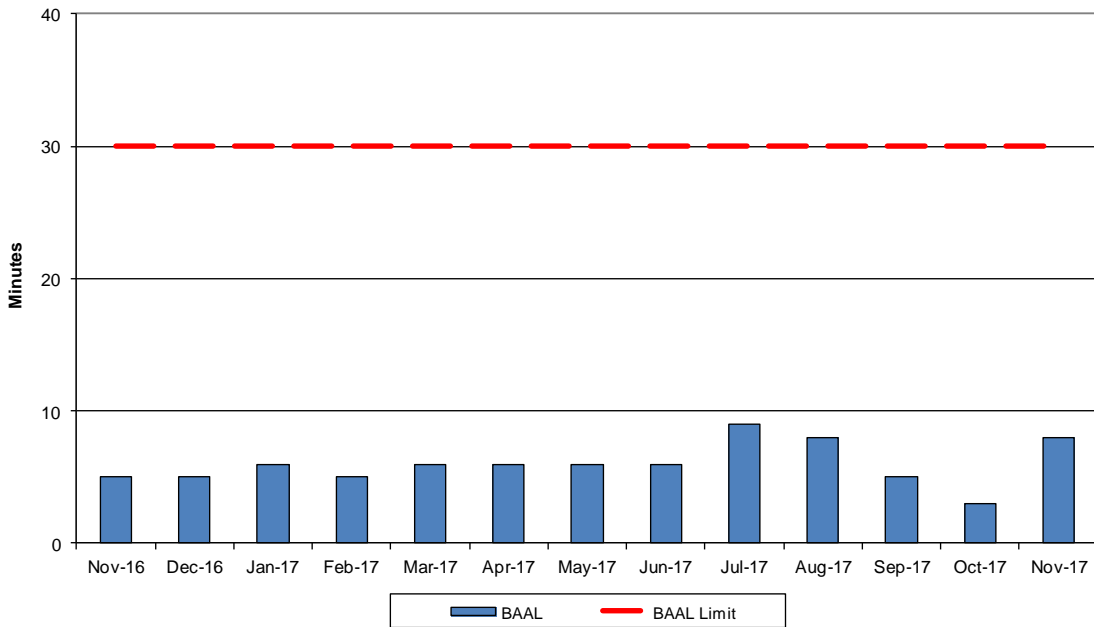


The amount of time the clock-minute average ACE exceeds the clock-minute Balancing Authority ACE Limit (BAAL) is an indicator of the NYISO Area resource and demand balancing. The maximum BAAL exceedance time is identified. BAAL exceedances of less than 30 consecutive clock-minutes are NERC compliant.

### Reserve Activations

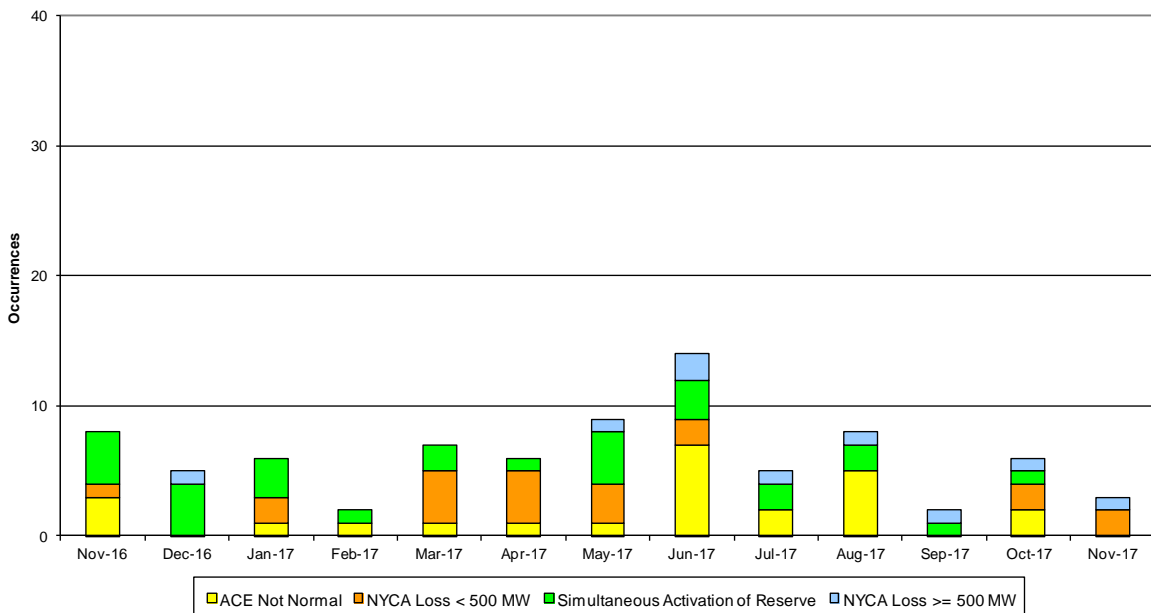


NYISO Reserve Activations are indicators of the need to respond to unexpected operational conditions within the NYISO Area or to assist a neighboring Area (Simultaneous Activation of Reserves) by activating an immediate resource and demand balancing operation.

### DCS Event Time to ACE Recovery


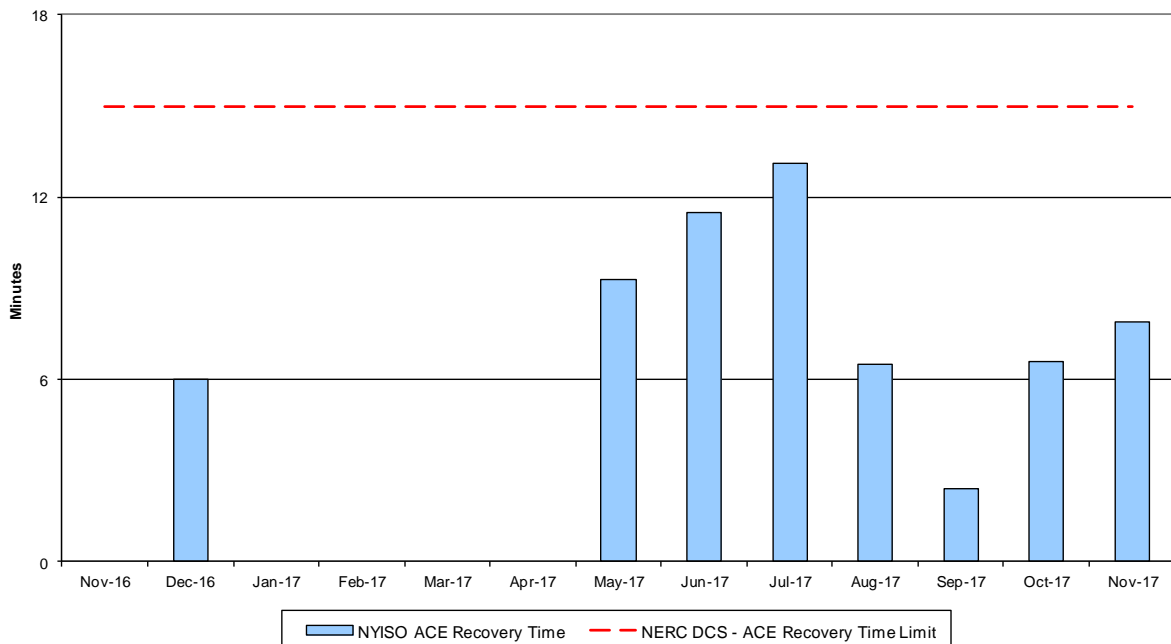


For NYISO initiated Reportable Disturbances, the maximum ACE recovery time is identified. Recovery times of less than 15 minutes are considered NERC compliant.



### Load Forecast Performance


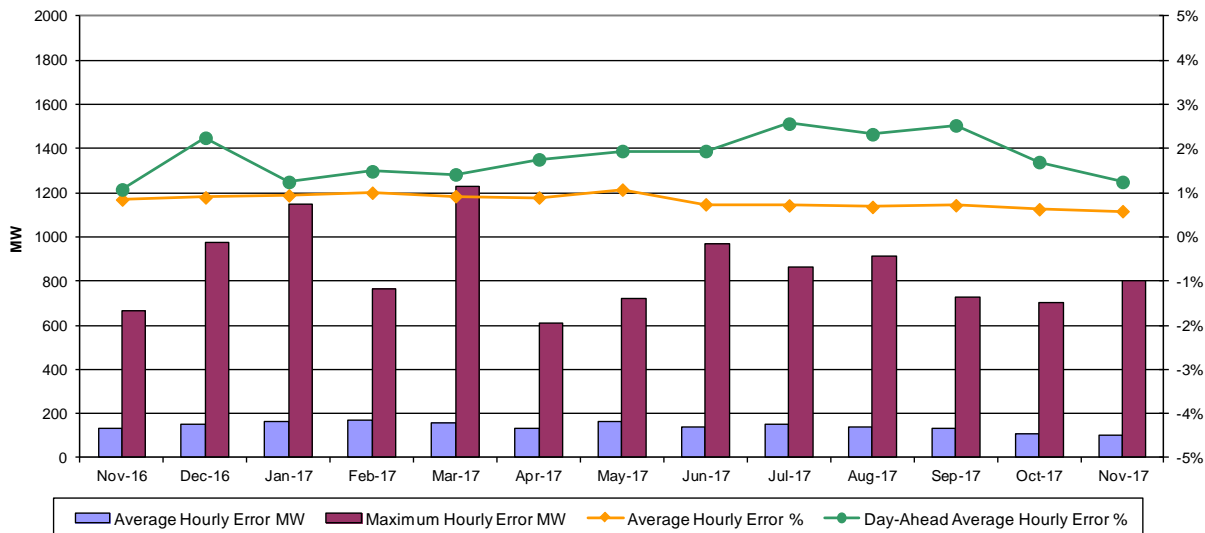




**Hourly Error MW** - Absolute value of the difference between the hourly average actual load demand and the average hour ahead forecast load demand.  
**Average Hourly Error %** - Average value of the ratio of hourly average error magnitude to hourly average actual load demand.  
**Day-Ahead Average Hourly Error %** - Average across all hours of the month of the absolute value of the difference between actual load demand and the Day-Ahead forecast load demand, divided by the actual load demand.

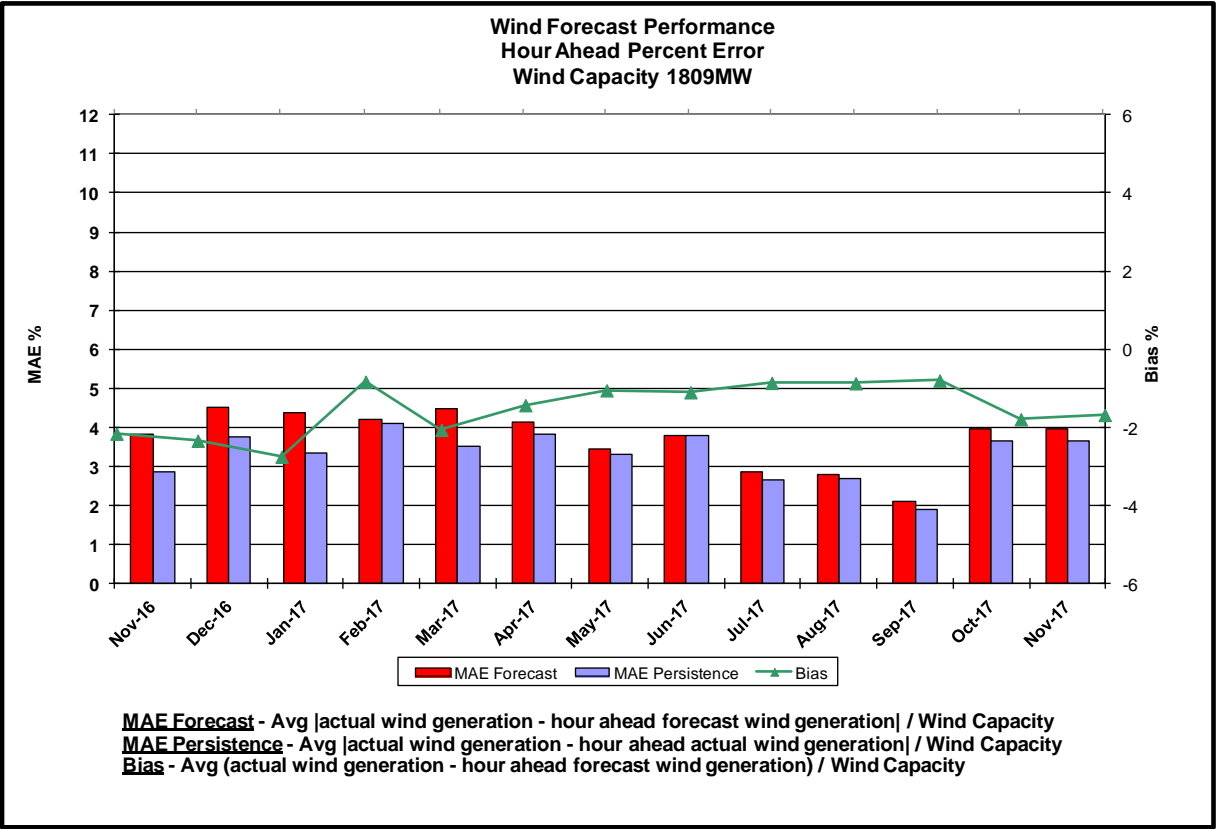
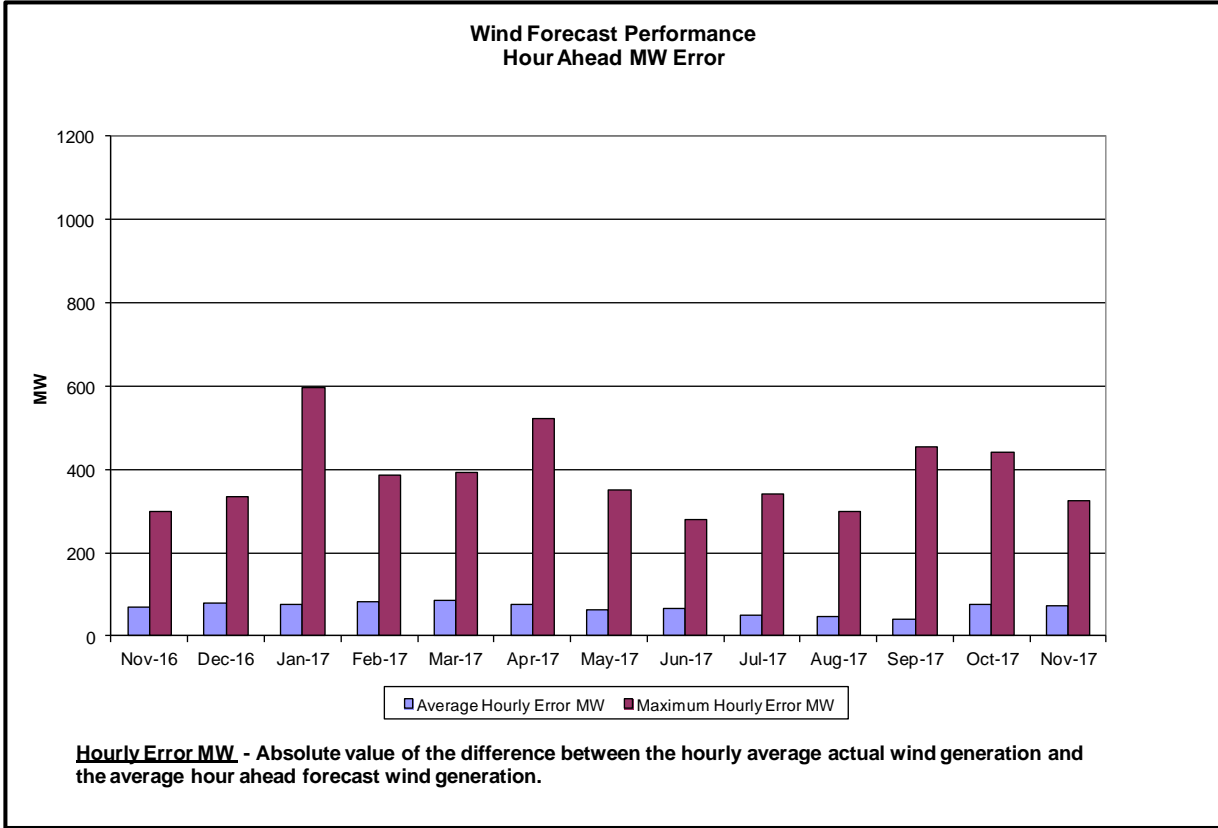




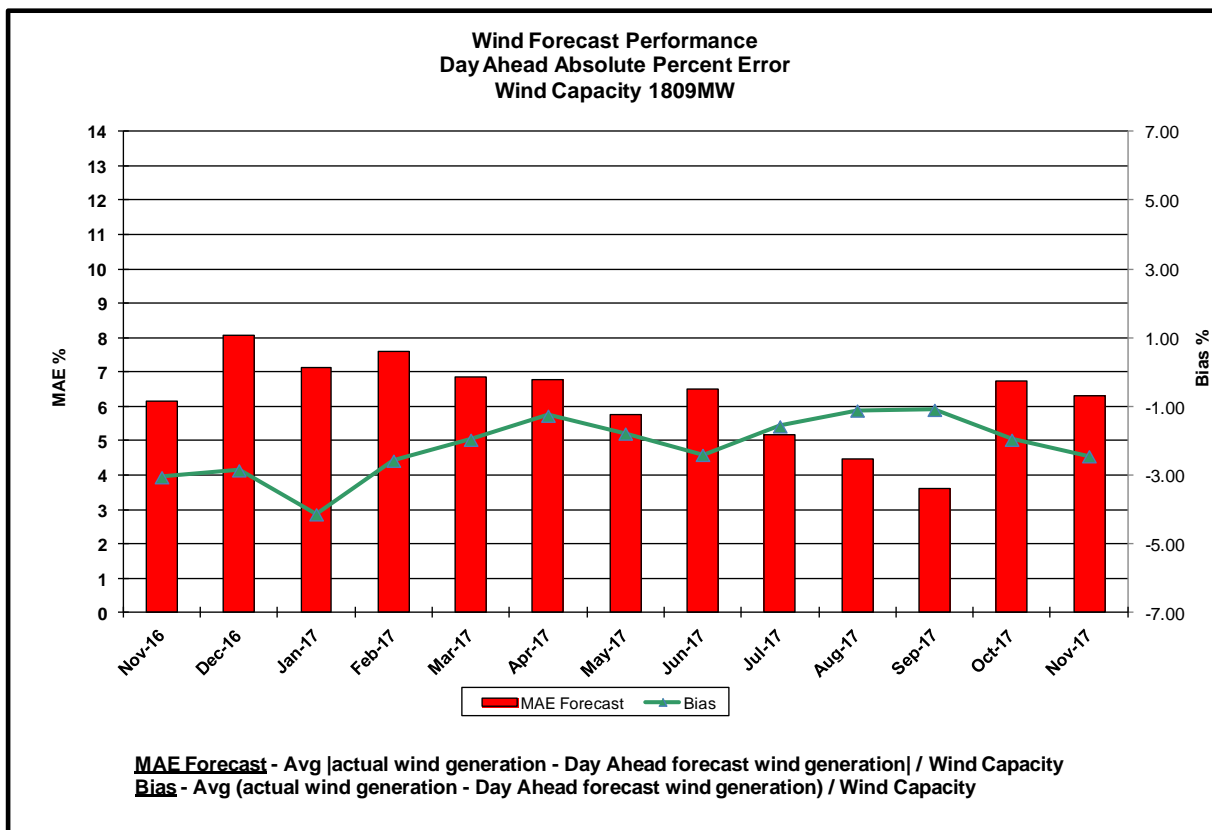
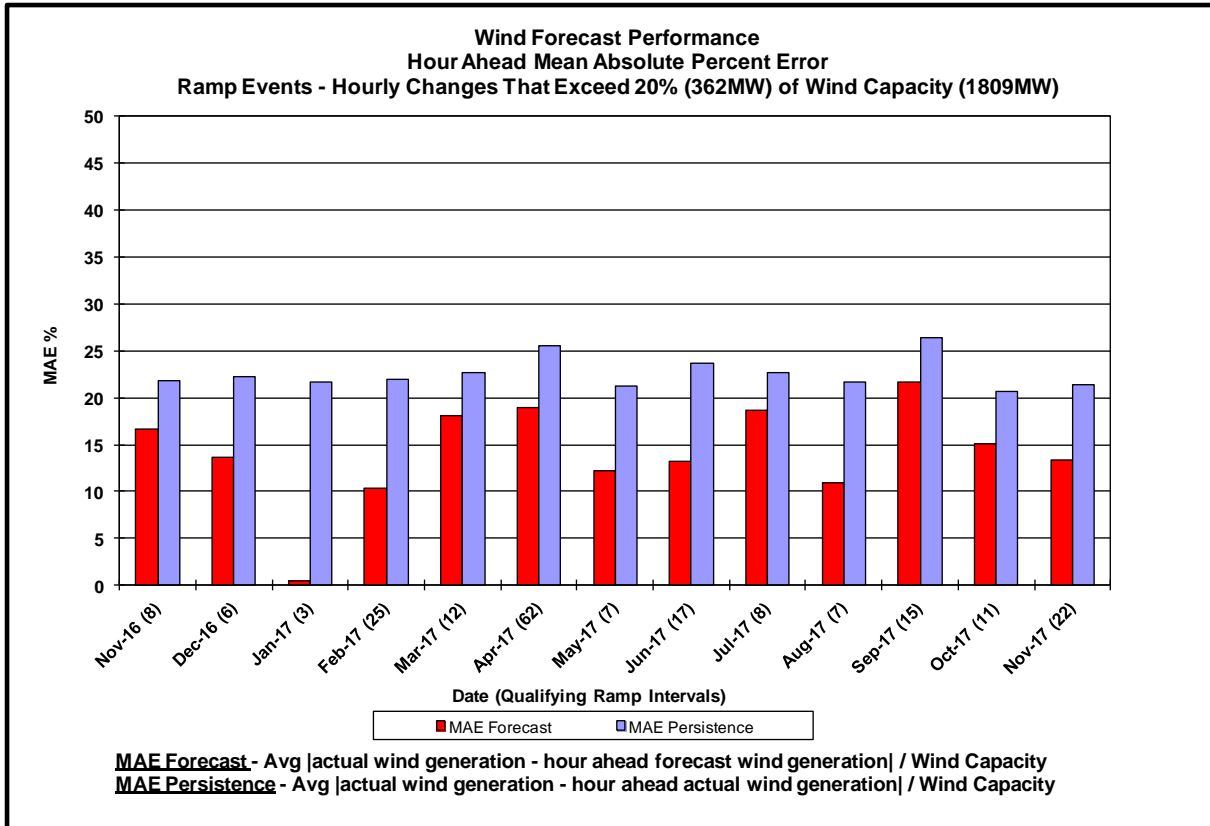


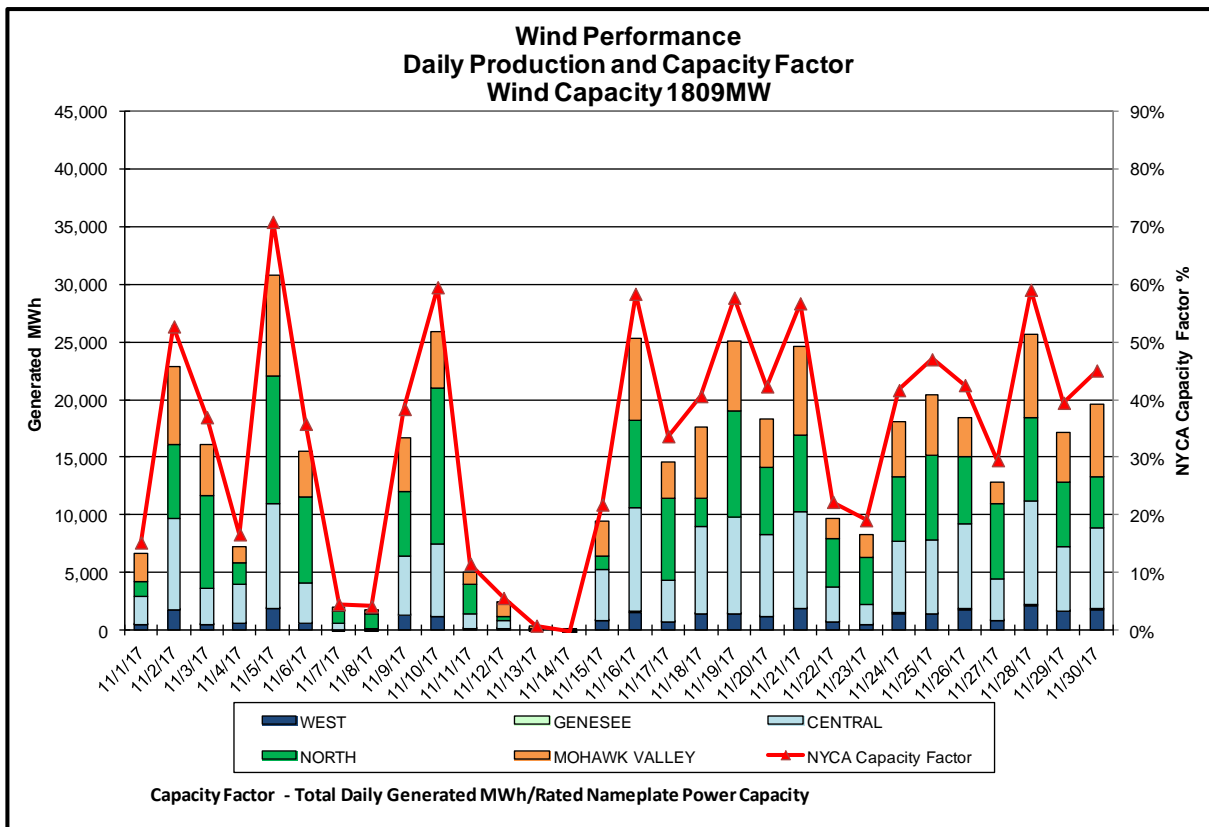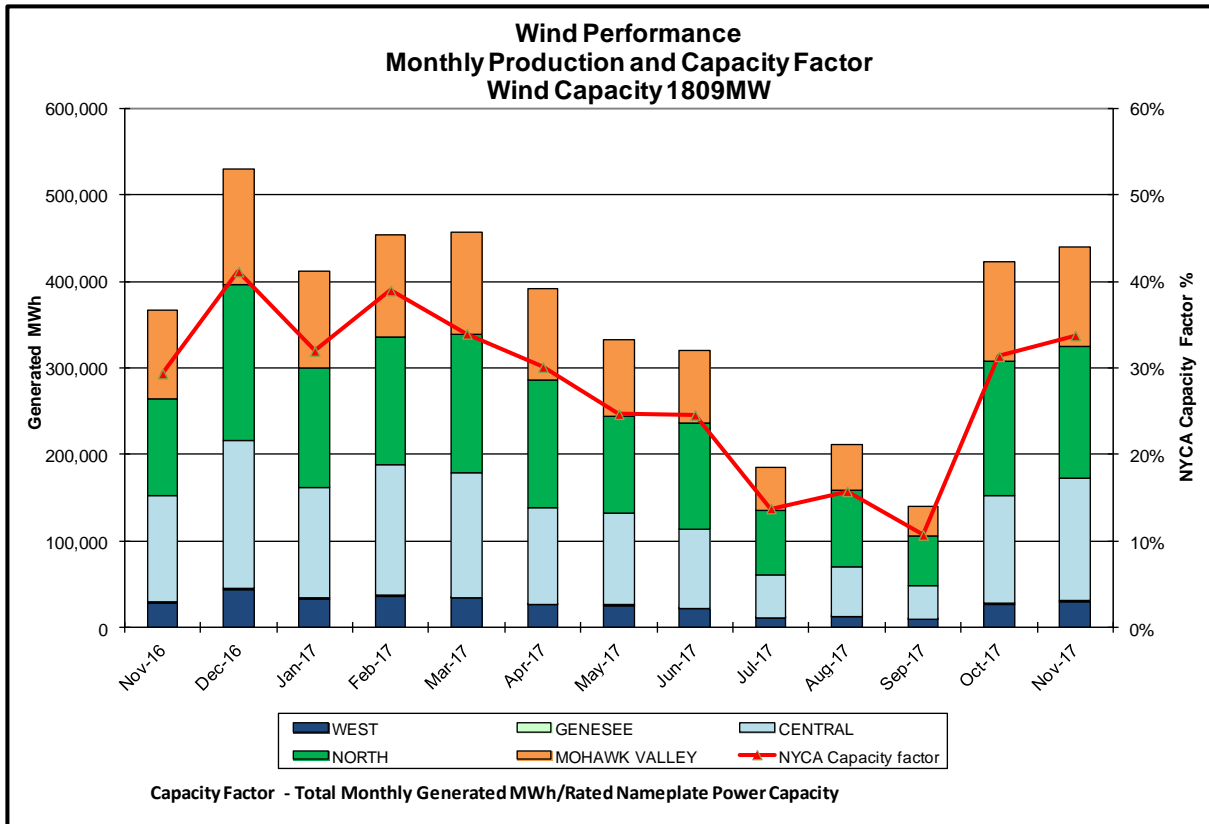

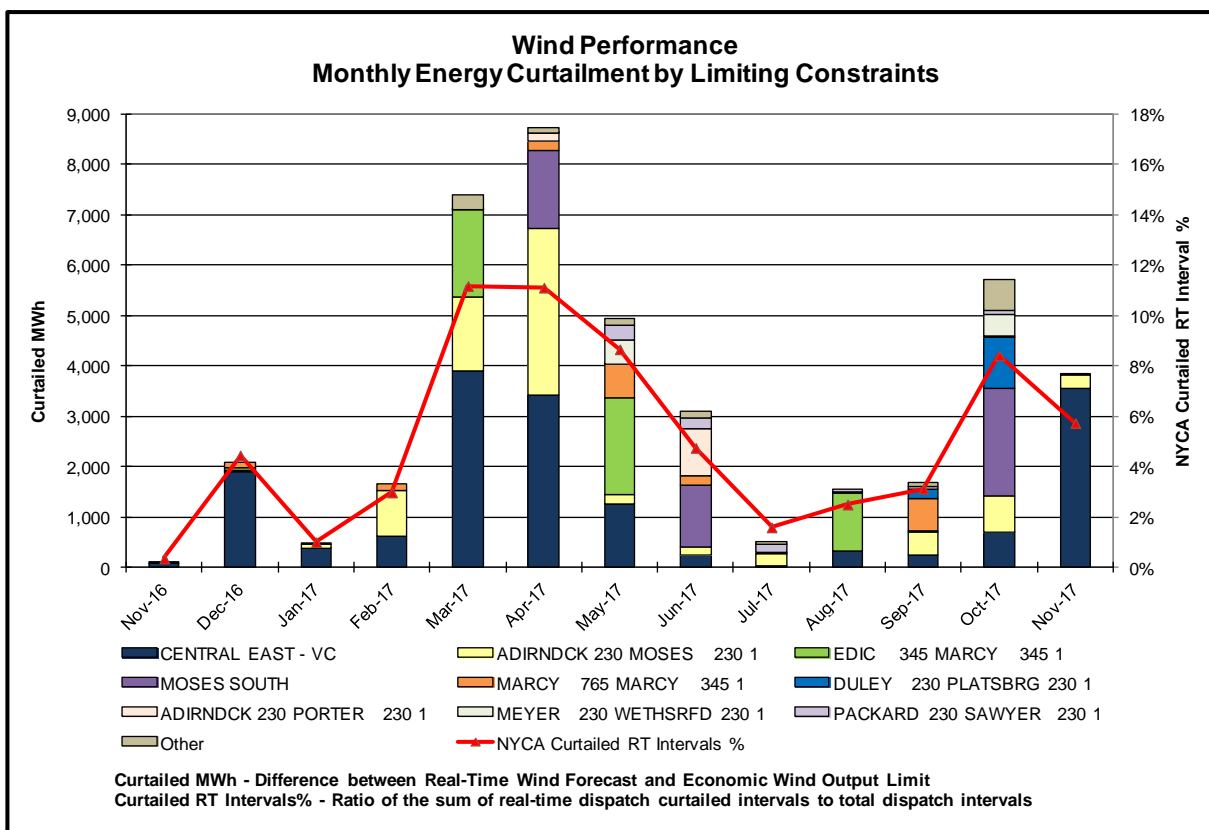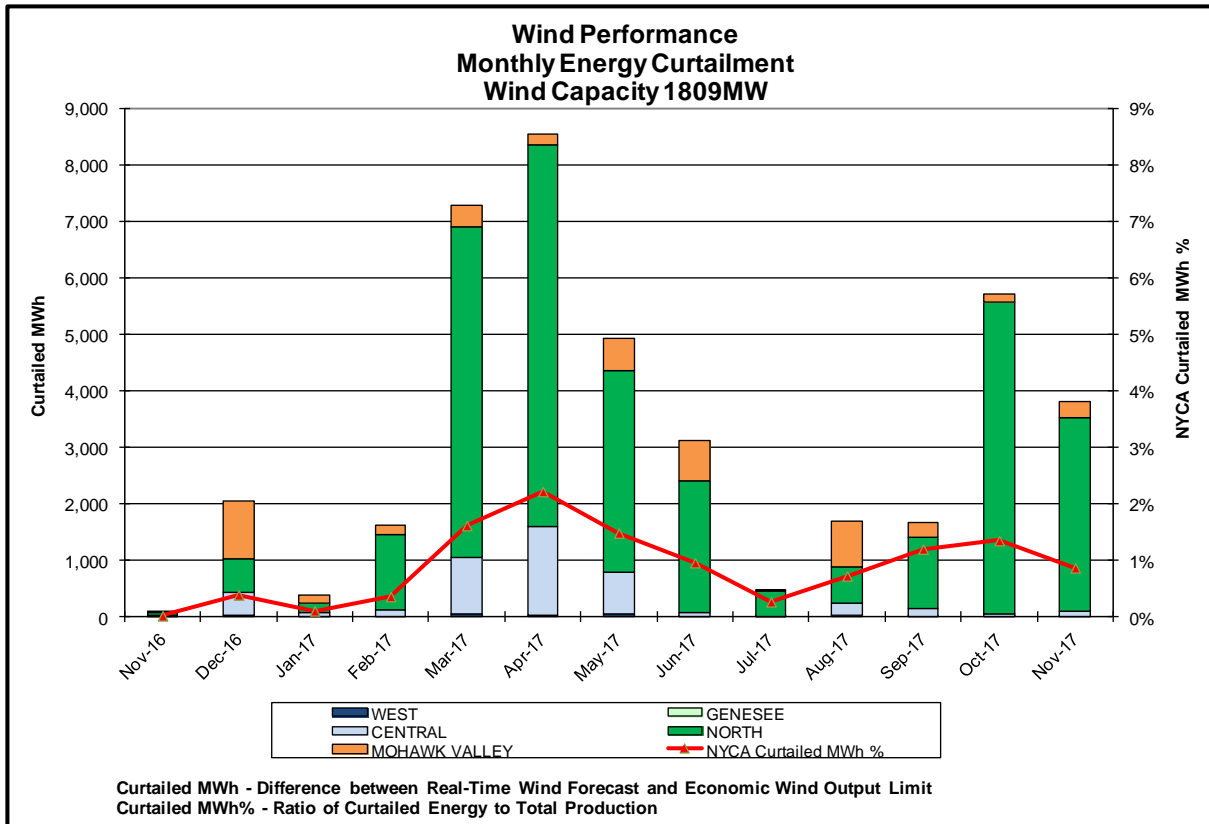

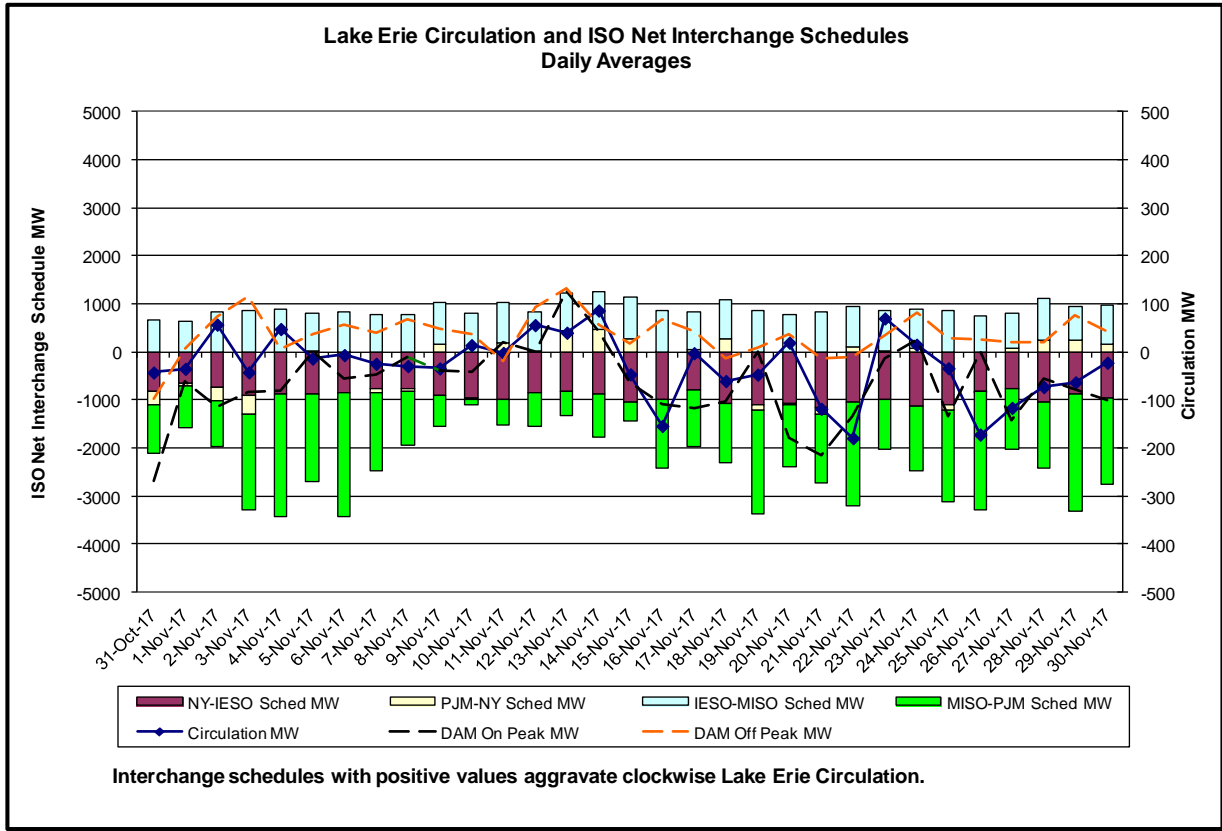
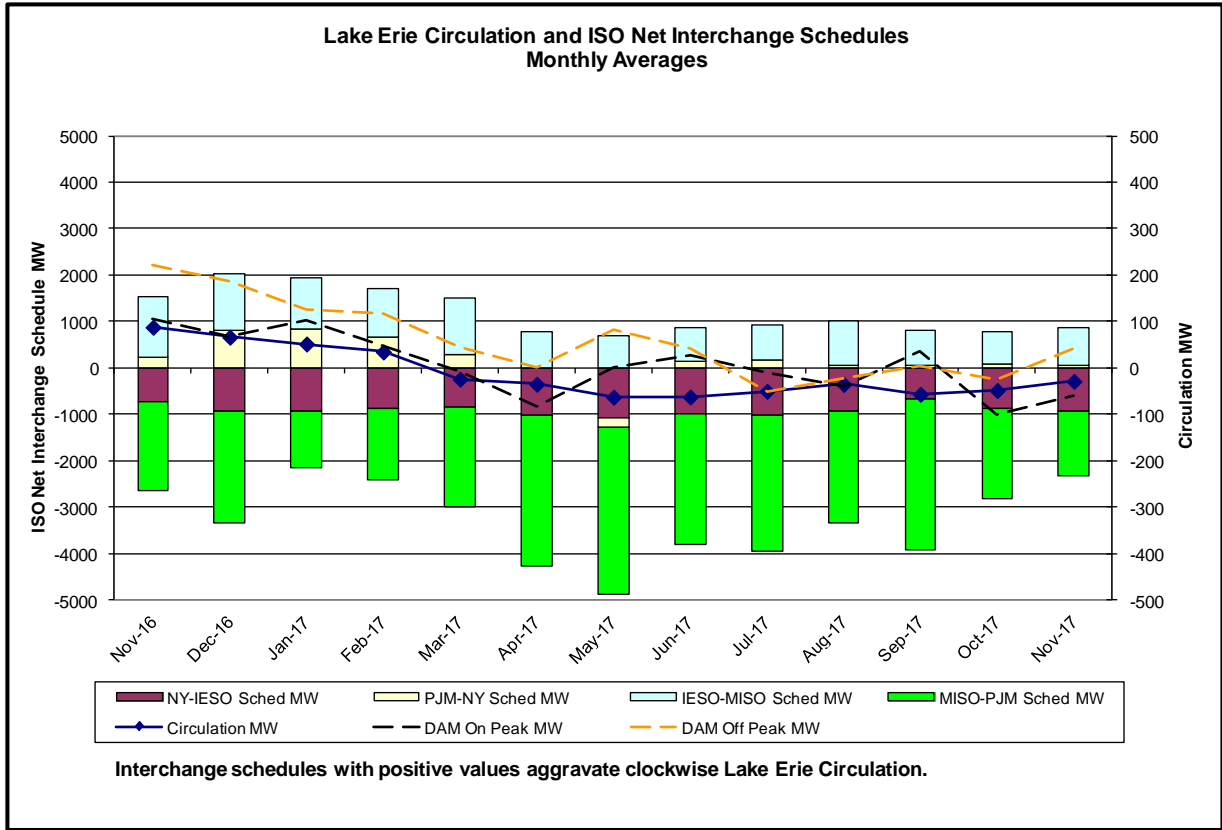


## Broader Regional Market Performance Metrics

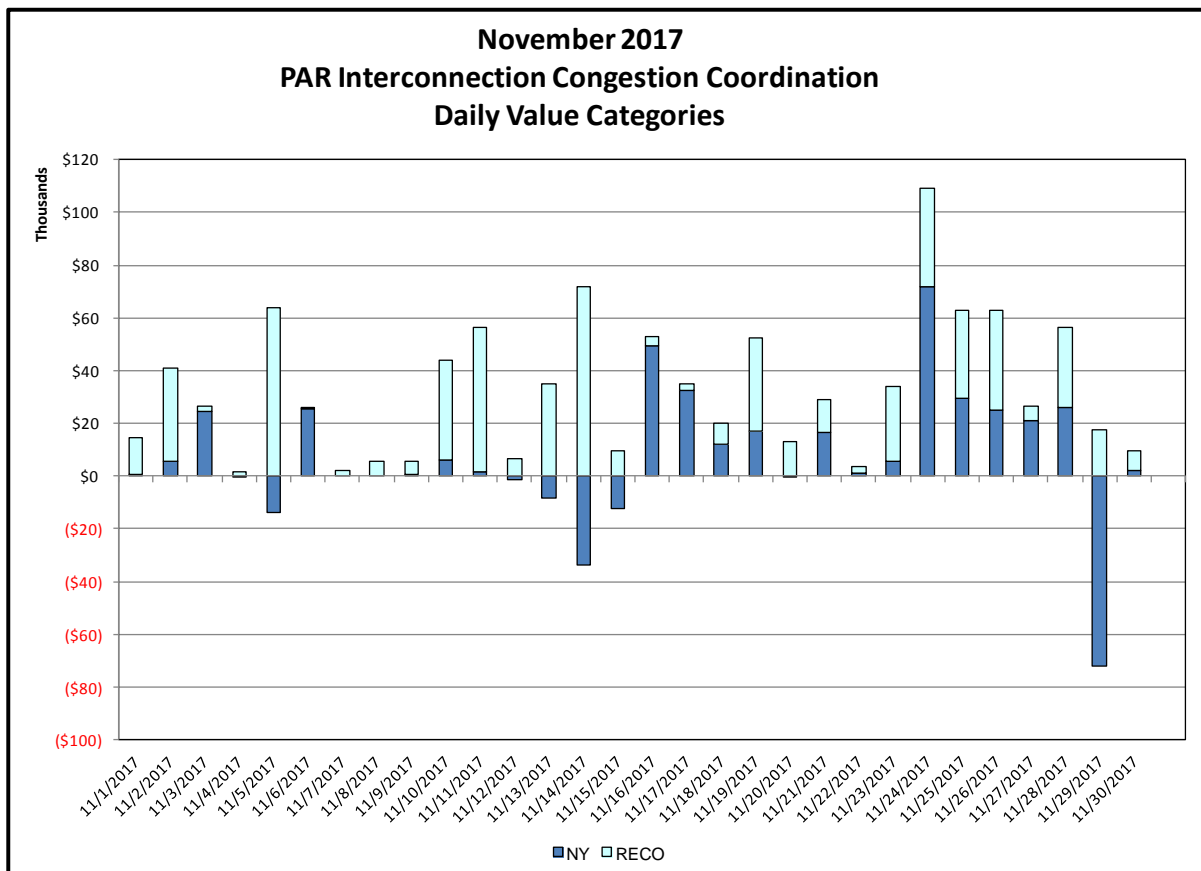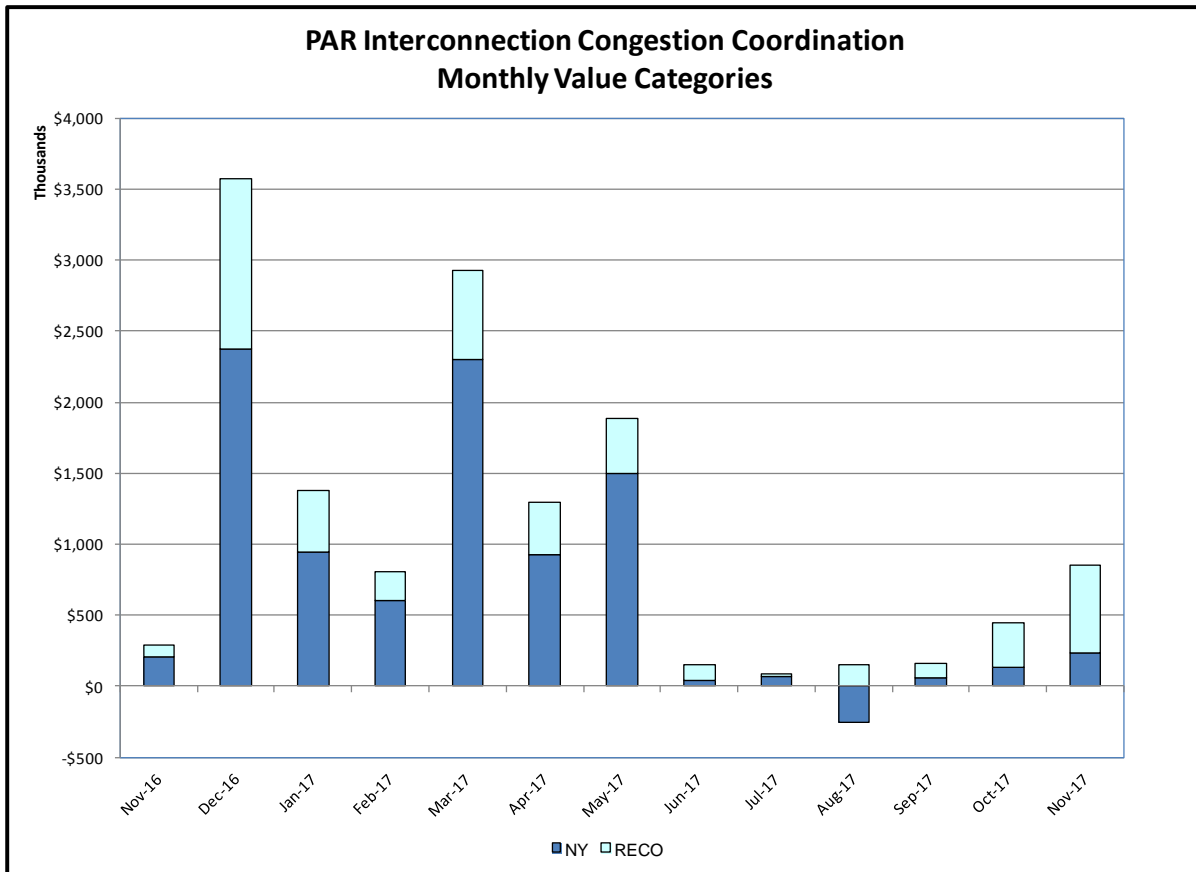

**PAR Interconnection Congestion Coordination**

<u>Category</u>	<u>Description</u>
NY	Represents the value NY realizes from Market-to-Market PAR Coordination. When experiencing congestion, this includes (1) the estimated savings to NY for additional deliveries into NY, plus (2) PJM compensation to NY for additional deliveries into PJM (as compared to the Interconnection PAR Target levels, excluding RECO on the Ramapo PARs). This is net of any settlements to PJM when they are congested.
RECO	Represents the value of PJM's obligation to deliver 80% of service to RECO load over Ramapo 5018. This includes (1) the estimated reduction in NYCA congestion due to the PJM delivery of RECO over Ramapo 5018, plus (2) PJM compensation to NY for NYCA congestion for the under-delivery or inability to deliver service to RECO load over Ramapo 5018.

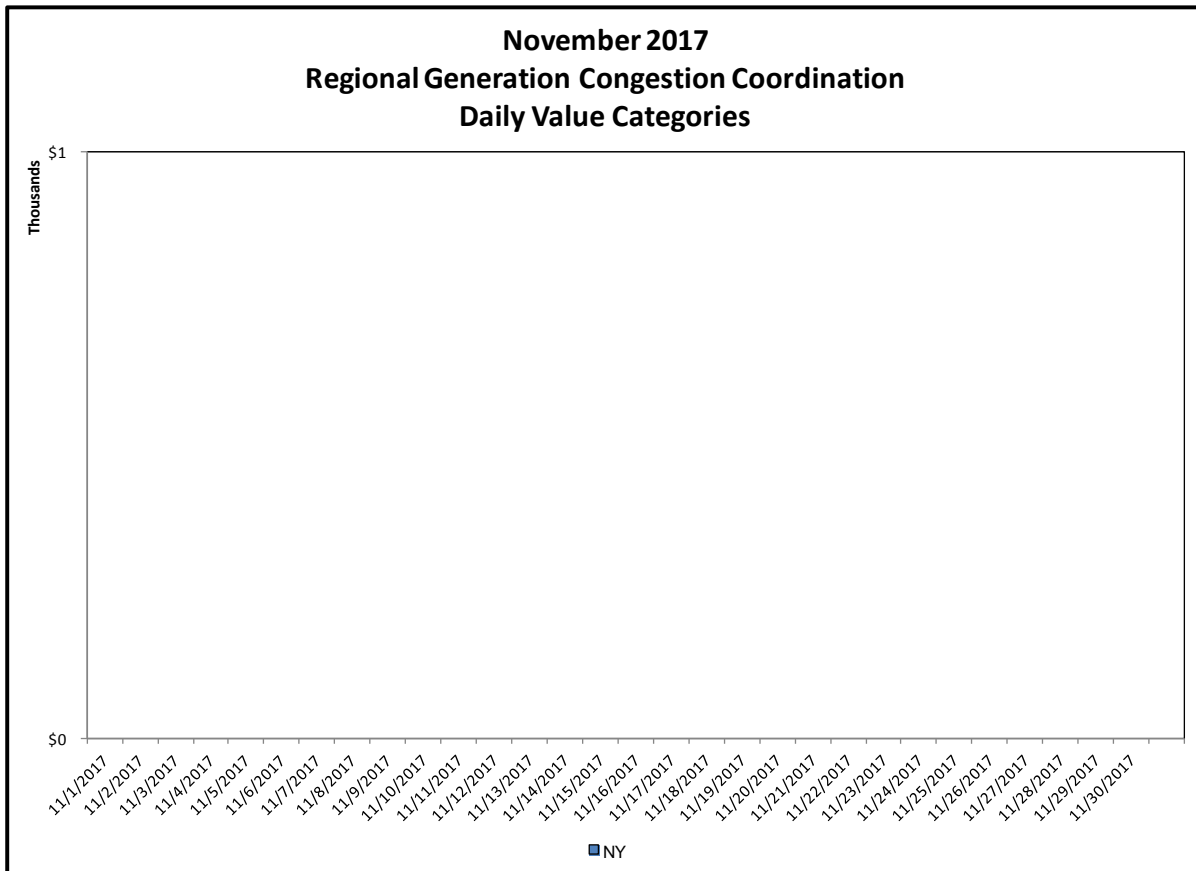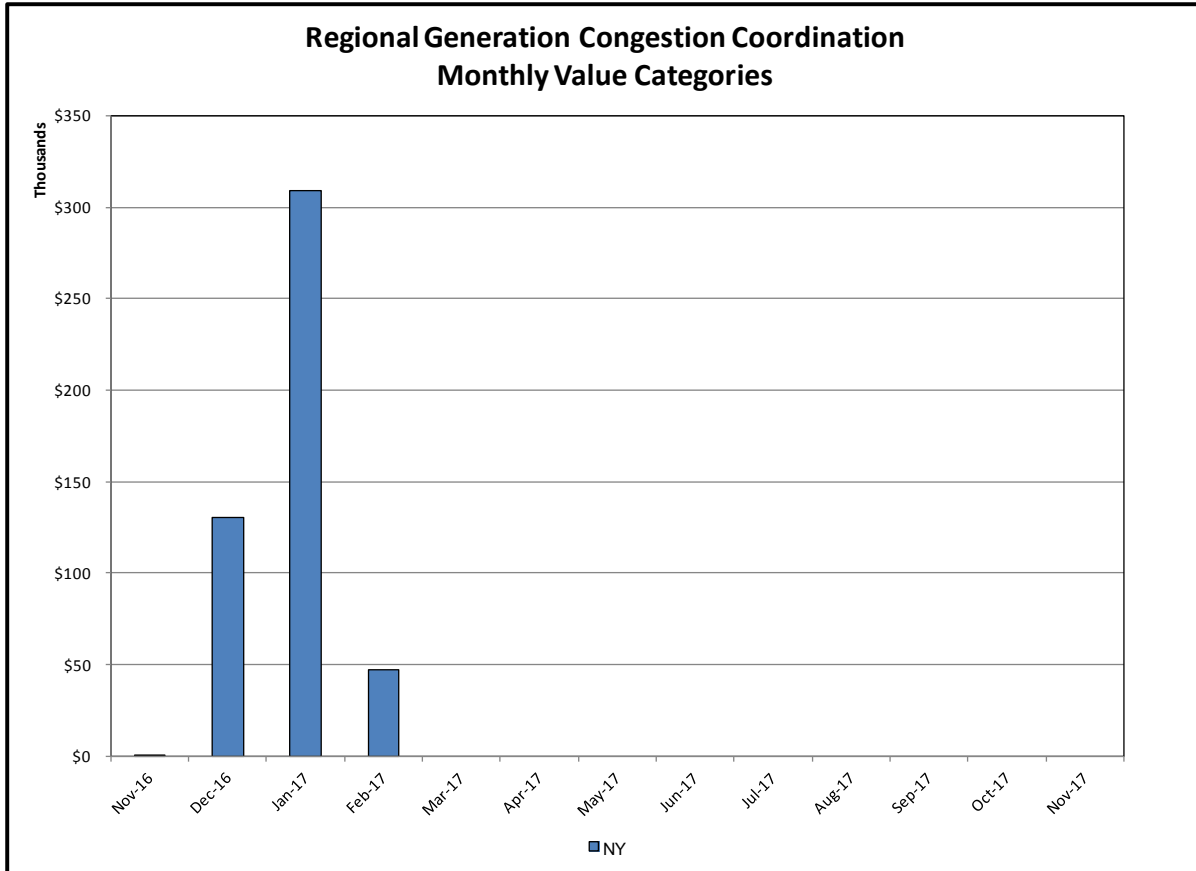

### Regional Generation Congestion Coordination



Category



NY

Description



NYISO savings that result from PJM payments to NYISO when PJM's transmission use (PJM's market flow) is greater than PJM's entitlement of the NY transmission system and NYISO is incurring Western or Central NY congestion. Additionally, NYISO savings may result from the more efficient regional utilization of PJM's generation resources to directly address Western or Central NY transmission congestion.



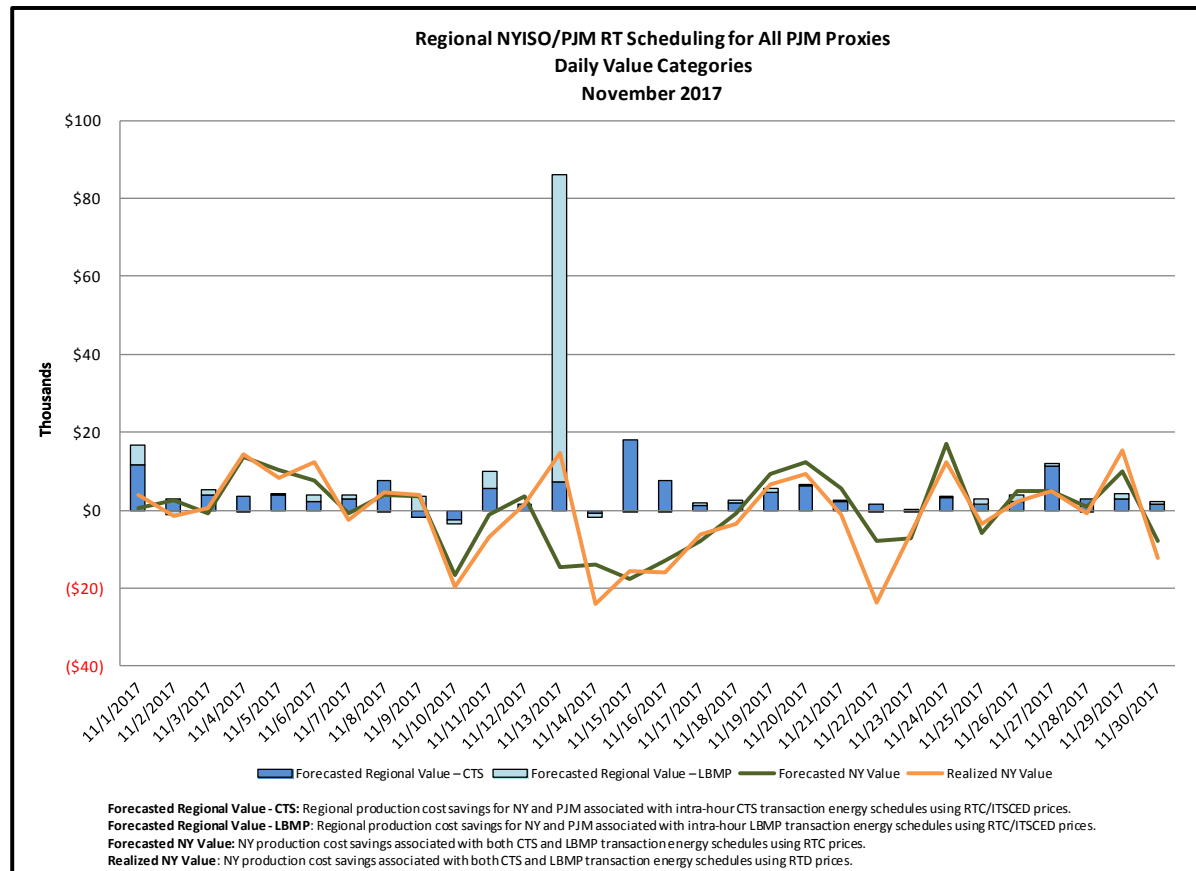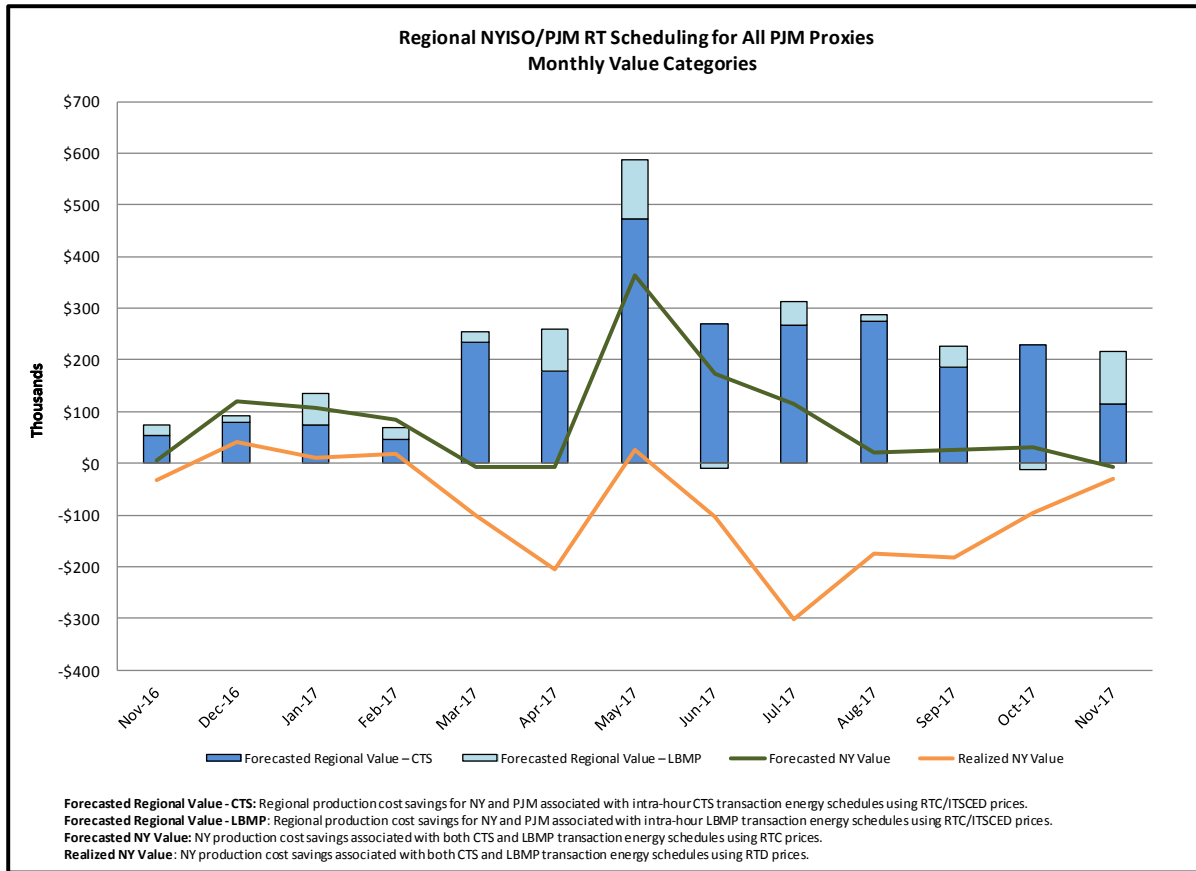

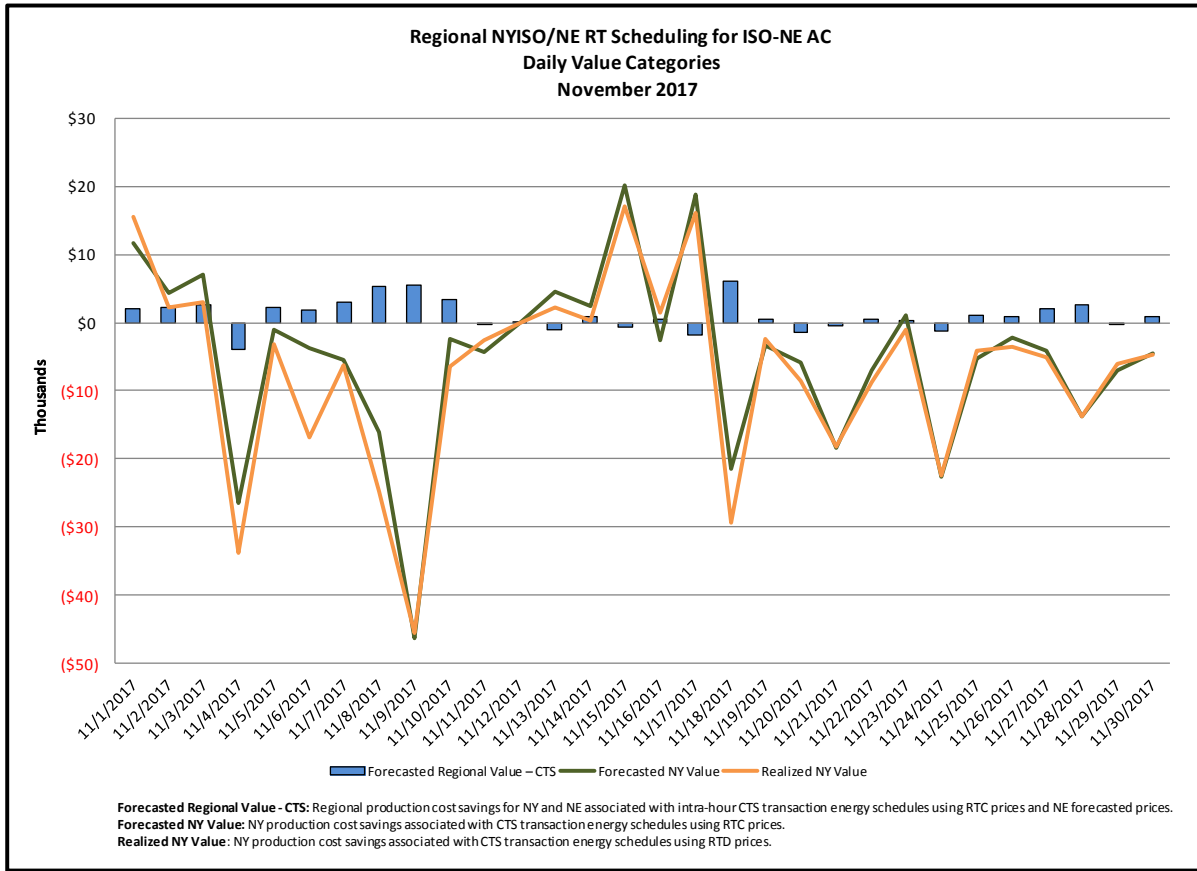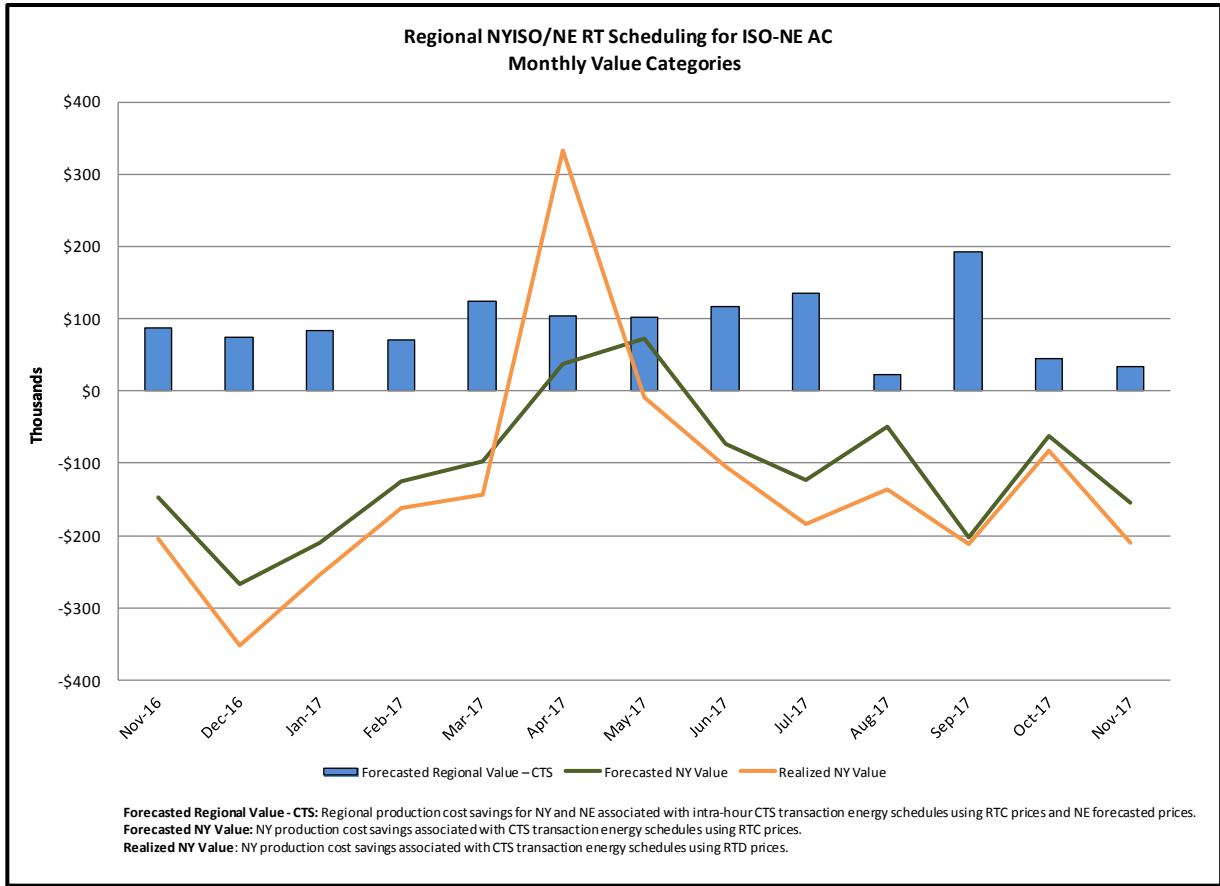

### Market Performance Metrics

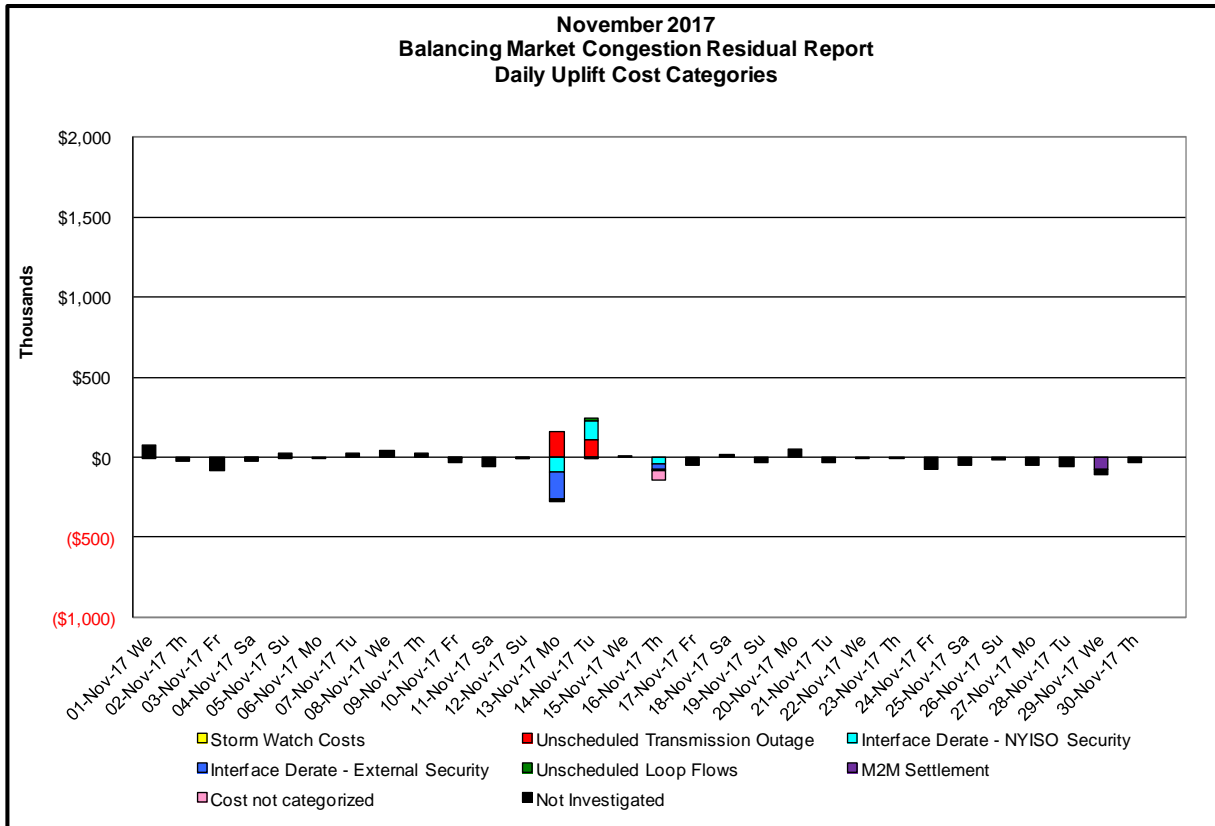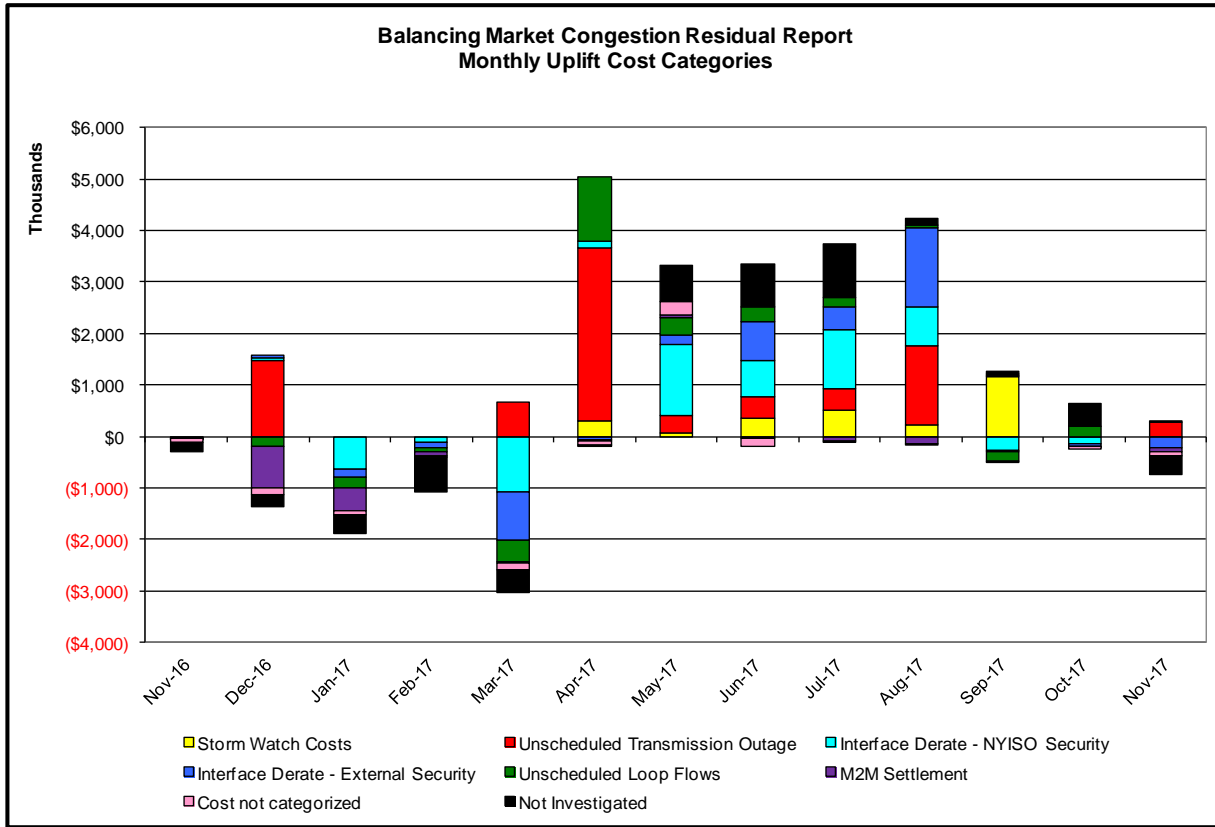



Day's investigated in November: 13,14,16			
Event	Date (yyyymmdd)	Hours	Description
	11/13/2017	7,8	Forced outage of Gowanus-Goethals 345kV (#26)
	11/13/2017	0,1,3,6	Uprate Central East
	11/13/2017	14,15	NYCA DNI Ramp Limit
	11/13/2017	0,1,3,6,10-16,18	NE_AC-NY Scheduling Limit
	11/13/2017	9,10	NE_AC DNI Ramp Limit
	11/13/2017	6,9-15	NE_NNC1385 - NY Scheduling Limit
	11/13/2017	10	Lake Erie Circulation, DAM-RTM exceeds +/-125MW: Central East
	11/13/2017	18	Lake Erie Circulation, DAM-RTM exceeds +/-125MW: Niagara-Packard
	11/14/2017	9-13,15-18,20,21	Forced outage of Gowanus-Goethals 345kV (#26)
	11/14/2017	9-13,15-18,20,21	Derate Dunwoodie-Shore Rd 345kV (#Y50)
	11/14/2017	13	Derate Niagara-Robinson Road 230kV (#64) for I/o TWR:PACKARD 77 & 78
	11/14/2017	13,15-17	Derate Packard-Sawyer 230kV (#78) for I/o Packard-Sawyer 230kV (#77)
	11/14/2017	15-17	Lake Erie Circulation, DAM-RTM exceeds +/-125MW: Packard-Sawyer
	11/16/2017	0-6	Uprate Central East
	11/16/2017	0-5	NE_AC DNI Ramp Limit
	11/16/2017	5,6	Lake Erie Circulation, DAM-RTM exceeds +/-125MW: Central East

**Real-Time Balancing Market Congestion Residual (Uplift Cost) Categories**




<u>Category</u>	<u>Cost Assignment</u>	<u>Events Types</u>	<u>Event Examples</u>
Storm Watch	Zone J	Thunderstorm Alert (TSA)	TSA Activations
Unscheduled Transmission Outage	Market-wide	Reduction in DAM to RTM transfers related to unscheduled transmission outage	Forced Line Outage, Unit AVR Outages
Interface Derate - NYISO Security	Market-wide	Reduction in DAM to RTM transfers not related to transmission outage	Interface Derates due to RTM voltages
Interface Derate - External Security	Market-wide	Reduction in DAM to RTM transfers related to External Control Area Security Events	TLR Events, External Transaction Curtailments
Unscheduled Loop Flows	Market-wide	Changes in DAM to RTM unscheduled loop flows impacting NYISO Interface transmission constraints	DAM to RTM Lake Erie Loop Flows exceeding +/- 125 MW
M2M Settlement	Market-wide	Settlement result inclusive of coordinated redispatch and Ramapo flowgates	

**Monthly Balancing Market Congestion Report Assumptions/Notes**

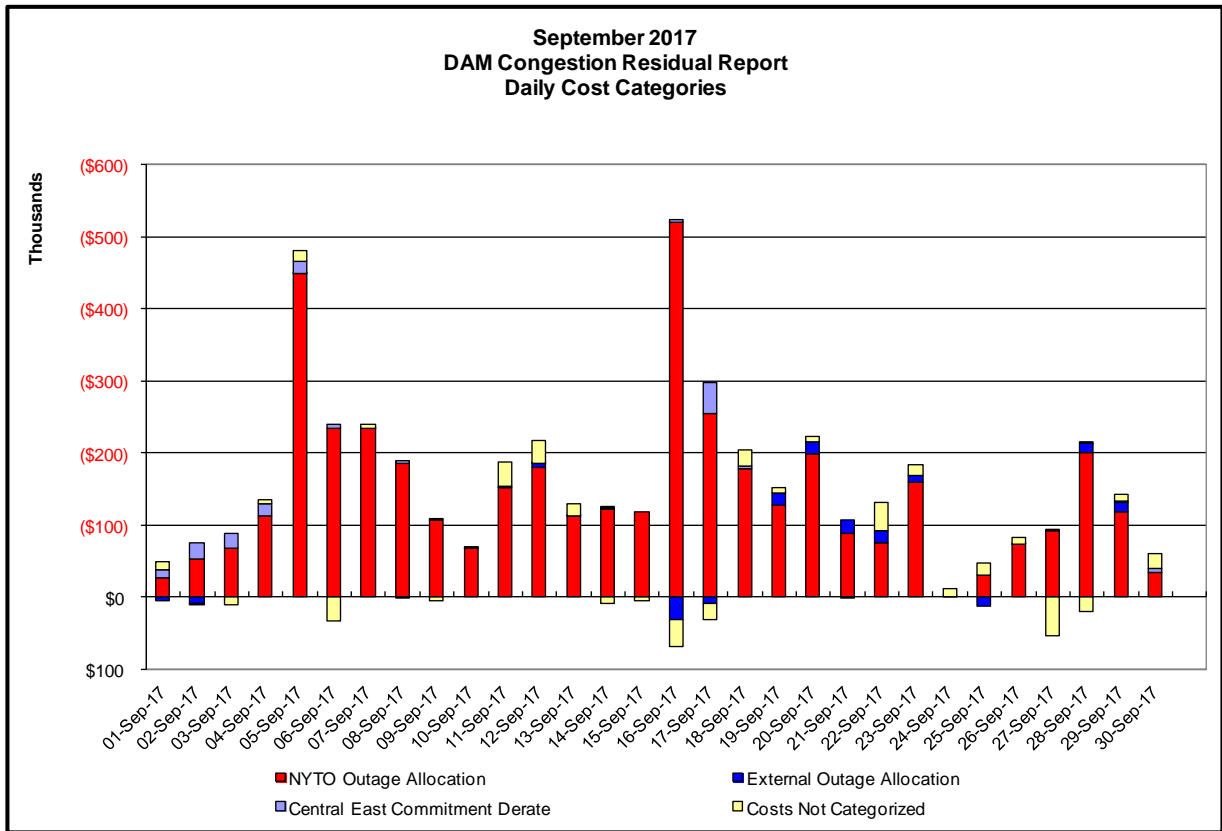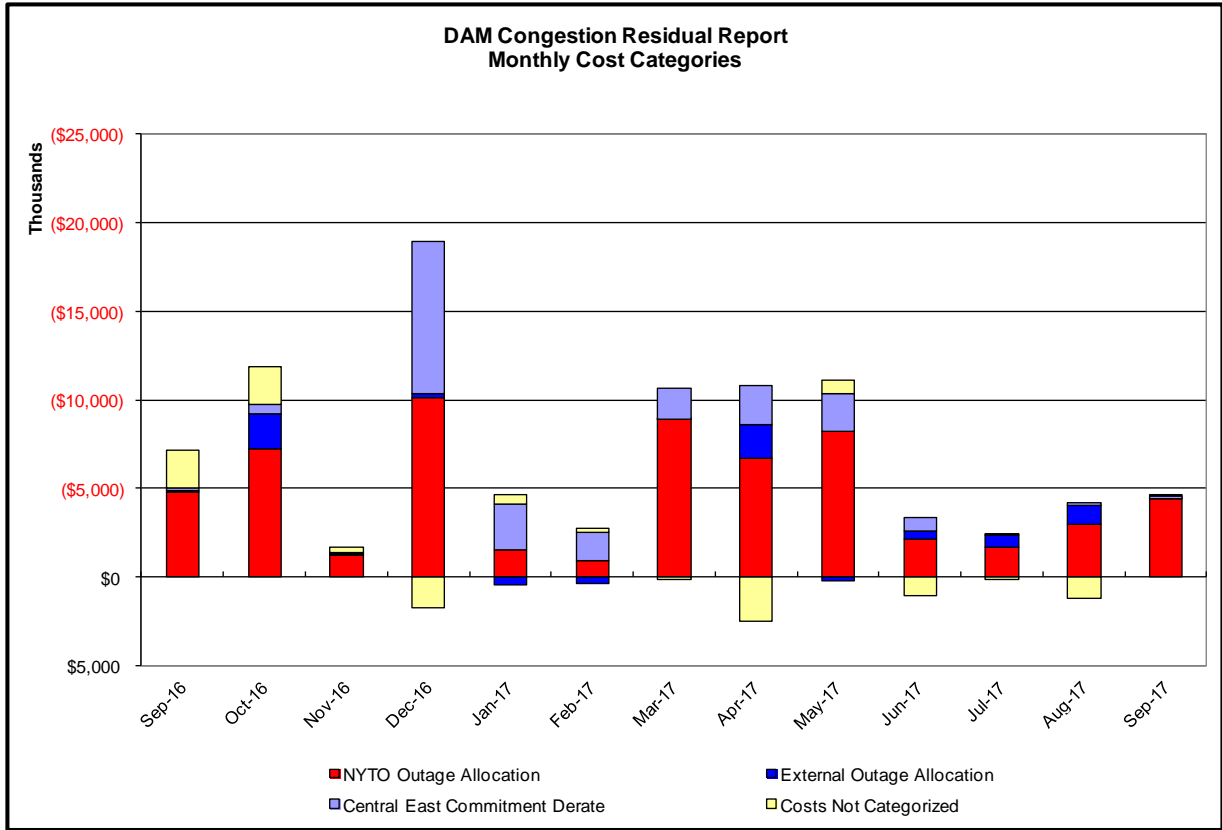- 1) Storm Watch Costs are identified as daily total uplift costs
- 2) Days with a value of BMCR less M2M Settlement of \$100K/HR, shortfall of \$200K/Day or more, or surplus of \$100K/Day or more are investigated.
- 3) Uplift costs associated with multiple event types are apportioned equally by hour



**Day-Ahead Market Congestion Residual Categories**

<u>Category</u>	<u>Cost Assignment</u>	<u>Events Types</u>	<u>Event Examples</u>
 NYTO Outage Allocation	Responsible TO	Direct allocation to NYTO's responsible for transmission equipment status change.	DAM scheduled outage for equipment modeled in-service for the TCC Auction.
 External Outage Allocation	All TO by Monthly Allocation Factor	Direct allocation to transmission equipment status change caused by change in status of external equipment.	Tie line required out-of-service by TO of neighboring control area.
 Central East Commitment Derate	All TO by Monthly Allocation Factor	Reductions in the DAM Central East_VC limit as compared to the TCC Auction limit, which are not associated with transmission line outages.	

