

# Alternative Methods for Determining LCRs

---

Zachary Stines

Associate Market Design Specialist

Installed Capacity Working Group

May 11, 2017, NYISO



DRAFT – FOR DISCUSSION PURPOSES ONLY

©COPYRIGHT NYISO 2017. ALL RIGHTS RESERVED

# Agenda

- **Phase 1: Proof of Concept**
  - Updates to the Optimization
  - Initial Sensitivities Results
- **Phase 2: Refining Methodology**
  - Transmission Security
  - Cost curves
- **Next Steps**
  - 2017 Project Development
- **Questions**

# Phase 1: Proof of Concept

# Updates to Optimization

- Altered formulation of LOLE constraint within optimization tool
  - Linear versus Log-Linear
- Reset solver with a smaller initial step size after a low initial tolerance has been met

# Updates Impact on Optimized Base Case

| Scenario                      | Zone J LCR (%) | Zone K LCR (%) | G-J LCR (%) | Cost (million) |
|-------------------------------|----------------|----------------|-------------|----------------|
| Optimized Base Case (Old)     | 78.1           | 104.5          | 92.2        | \$4,370.8      |
| Optimized Base Case (Updated) | 77.5           | 107.0          | 91.0        | \$4,366.4      |
| <b>Δ in Base Cases</b>        | <b>0.6</b>     | <b>-2.5</b>    | <b>1.2</b>  | <b>\$4.4</b>   |

- Updated Base Case results in a lower cost, but slightly different LCRs for the localities

# Initial Sensitivities

- **Entry/exit of Capacity**
  - Capacity addition/subtraction in Zone GHIJ
  - Capacity addition/subtraction in Zone J
  - Capacity addition/subtraction in Zone K
  - Capacity addition/subtraction in Rest of State
  - Capacity addition/subtraction in G with Lower Bound on Zone J
- **Changes in Net CONE**
  - Increase and decrease GHIJ Net CONE
  - Increase and decrease Zone J Net CONE
  - Increase and decrease Zone K Net CONE
  - Increase and decrease NYCA Net CONE
  - Increase in all Locality Net CONE
- **Changes in Transmission Capability**
  - Increase UPNY-SENY

# Methodologies used in Sensitivities

## ■ Optimization Methodology

- Uses GE Optimization tool and NYISO final 2017-2018 Capability Year LCR base case
- Optimized the 3 Localities' LCRs while maintaining the 2017 NYSRC approved IRM of 18% subject to a LOLE constraint of 0.1 Days/year

## ■ Current LCR Methodology

- Uses NYISO LCR Calculation Process<sup>1</sup>
- Not a full Unified Method (i.e., Tan45)
- Maintains the NYSRC approved IRM of 18%
- Used to provide a simple comparison

<sup>1</sup> This process is available at  
<[http://www.nyiso.com/public/webdocs/markets\\_operations/market\\_data/icap/Reference\\_Documents/LCR\\_Calculation\\_Process/LCR%20Calculation%20Process%202012\\_13\\_13.pdf](http://www.nyiso.com/public/webdocs/markets_operations/market_data/icap/Reference_Documents/LCR_Calculation_Process/LCR%20Calculation%20Process%202012_13_13.pdf)>.

# Current LCR Methodology Base Case


- The NYISO final 2017-2018 Capability Year LCR base case was solved to a LOLE of 0.1 days/year with the NYSRC approved IRM of 18.0%
- The resulting base case will allow for a direct comparison with the optimized methodology and the simplified current LCR methodology

| Scenario                | Zone J LCR (%) | Zone K LCR (%) | G-J LCR (%) | Cost (million) |
|-------------------------|----------------|----------------|-------------|----------------|
| Base Case (Current LCR) | 81.4           | 103.2          | 91.3        | \$4,407.7      |




# Changes in Capacity Sensitivities


# Changes to Capacity in GHJ: Zone J LCR

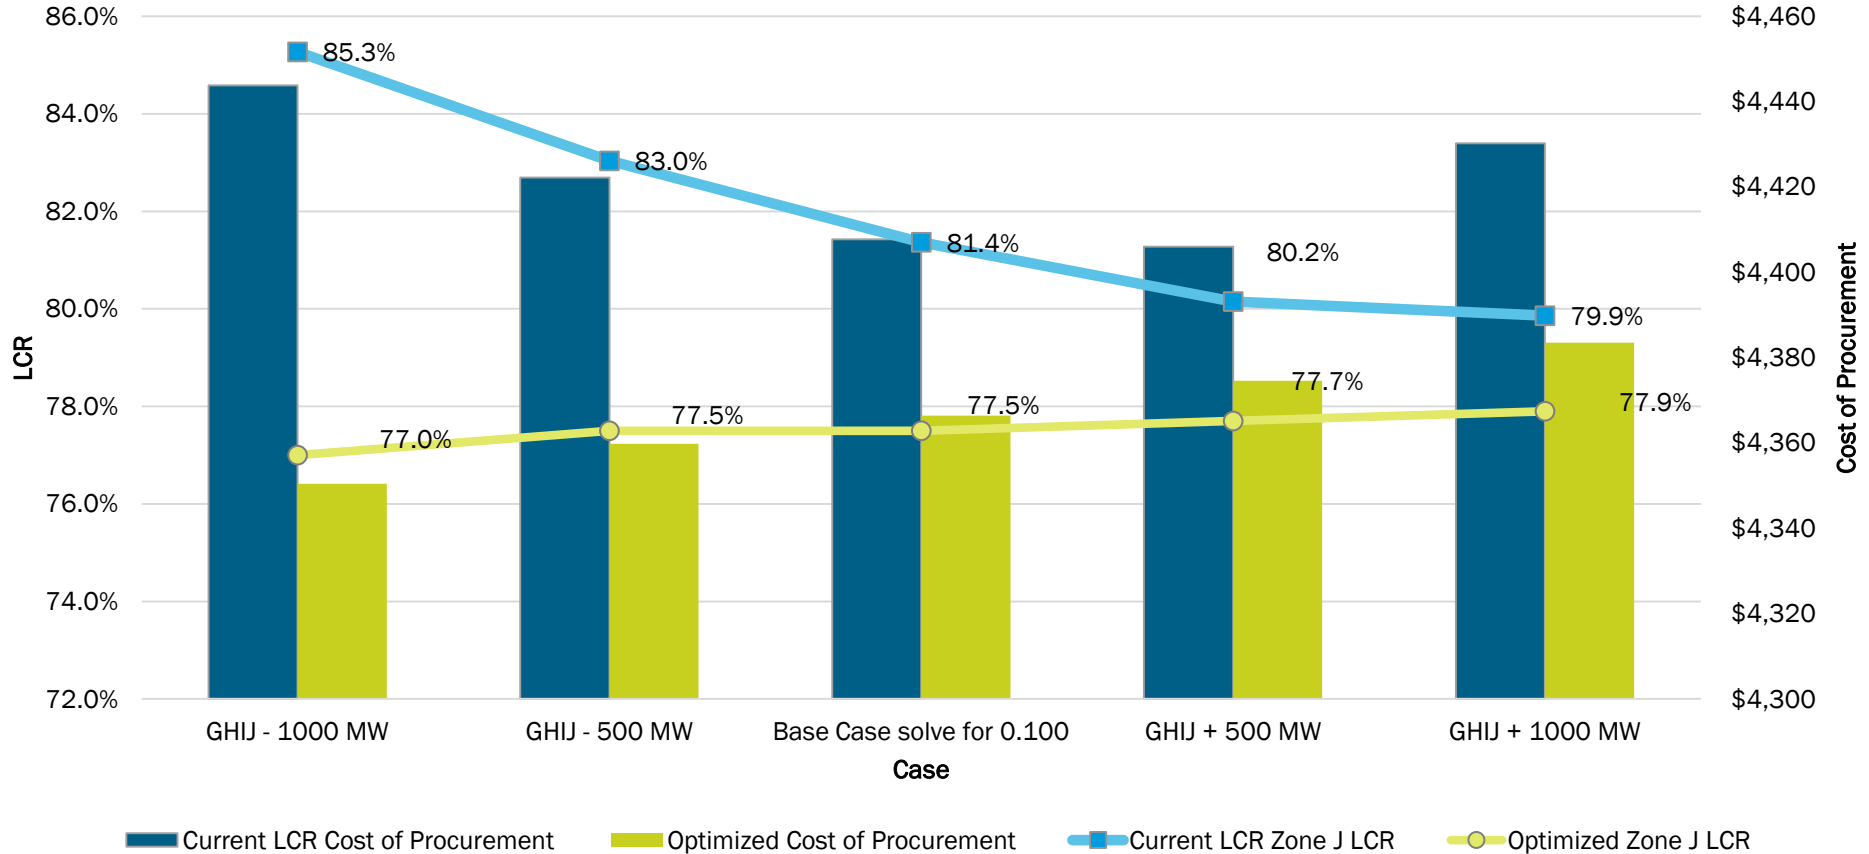


# Changes to Capacity in GHJ: Zone K LCR

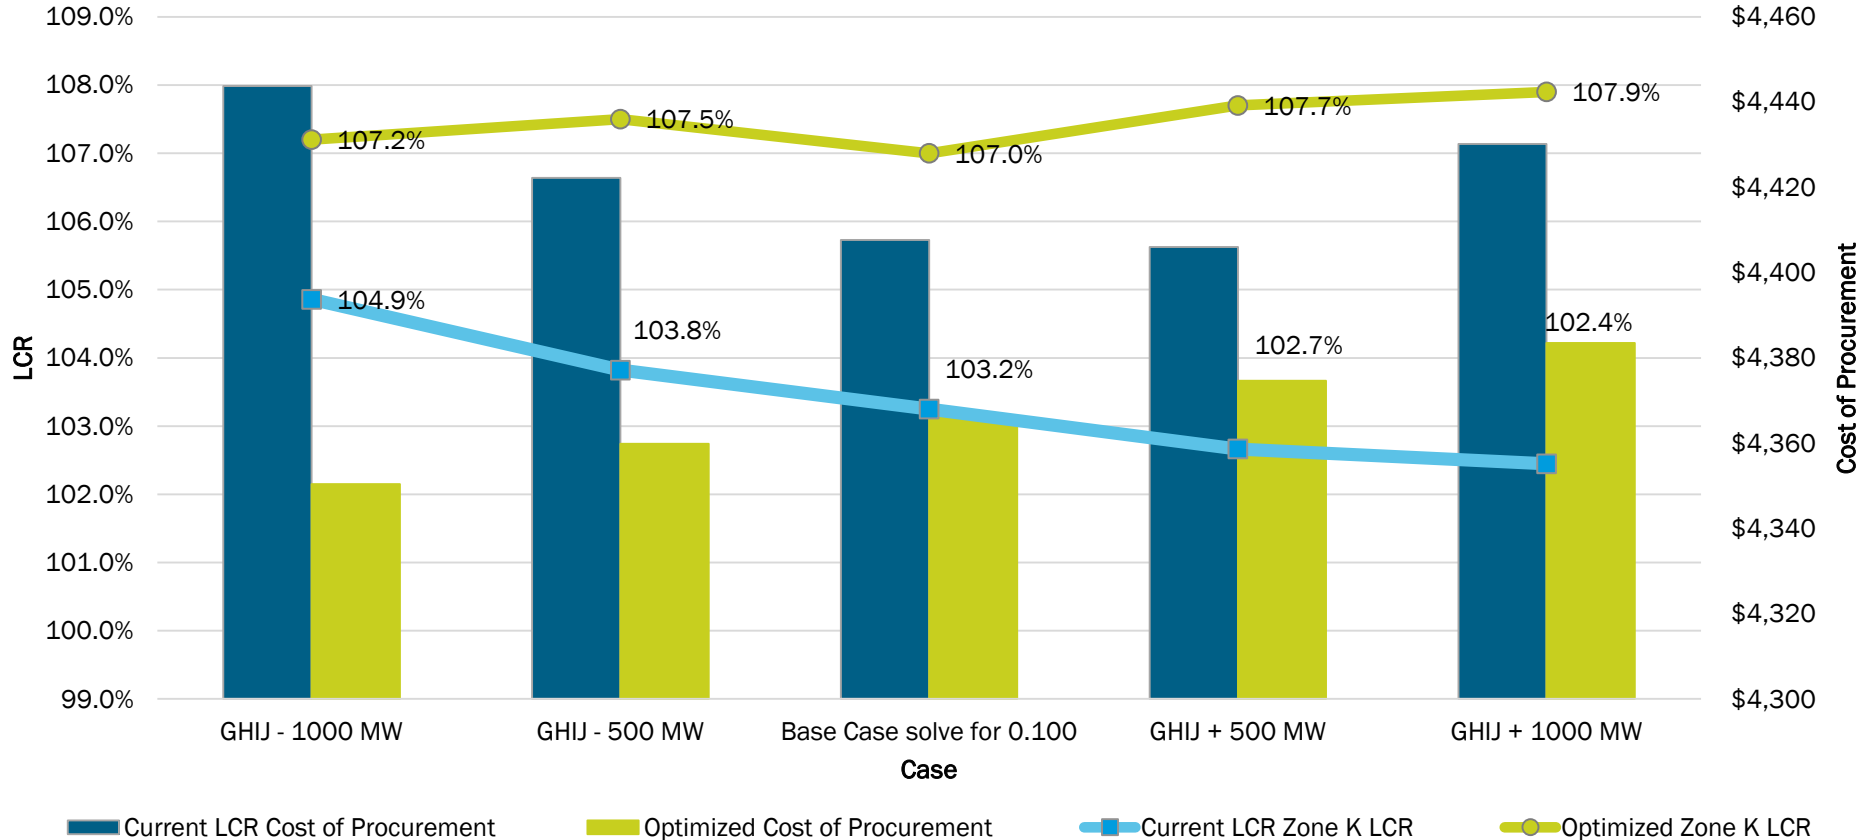


# Changes to Capacity in GHJ: GHJ LCR

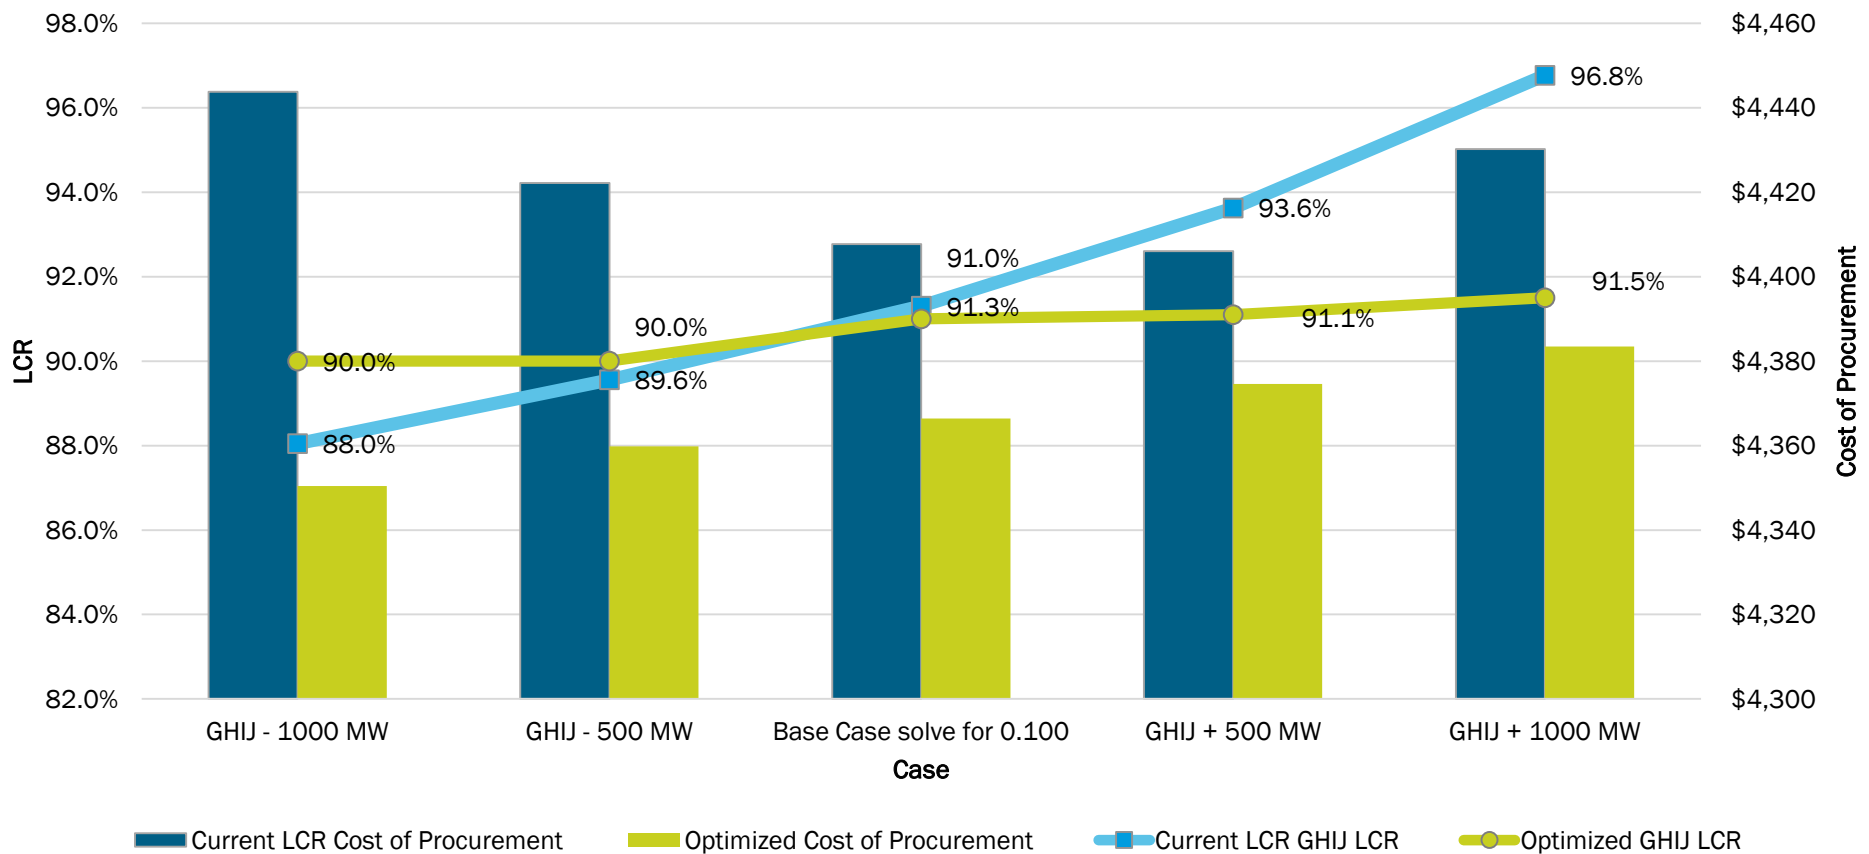


# Changes to Capacity in J: Zone J LCR

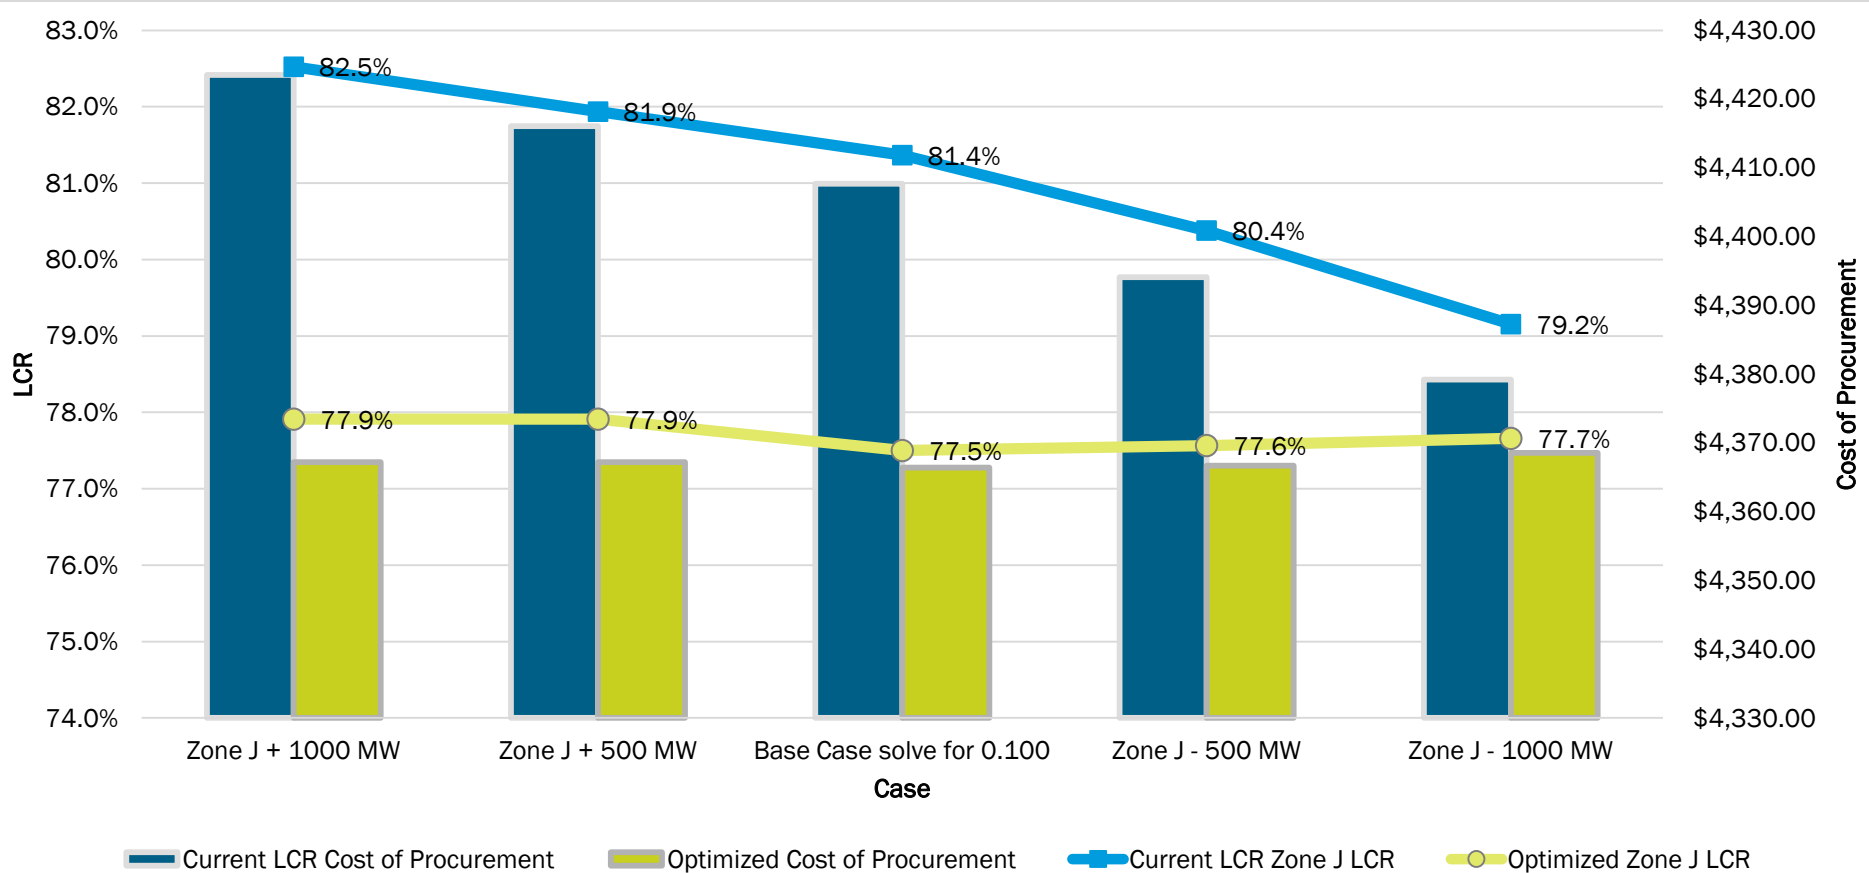


# Changes to Capacity in J: Zone K LCR

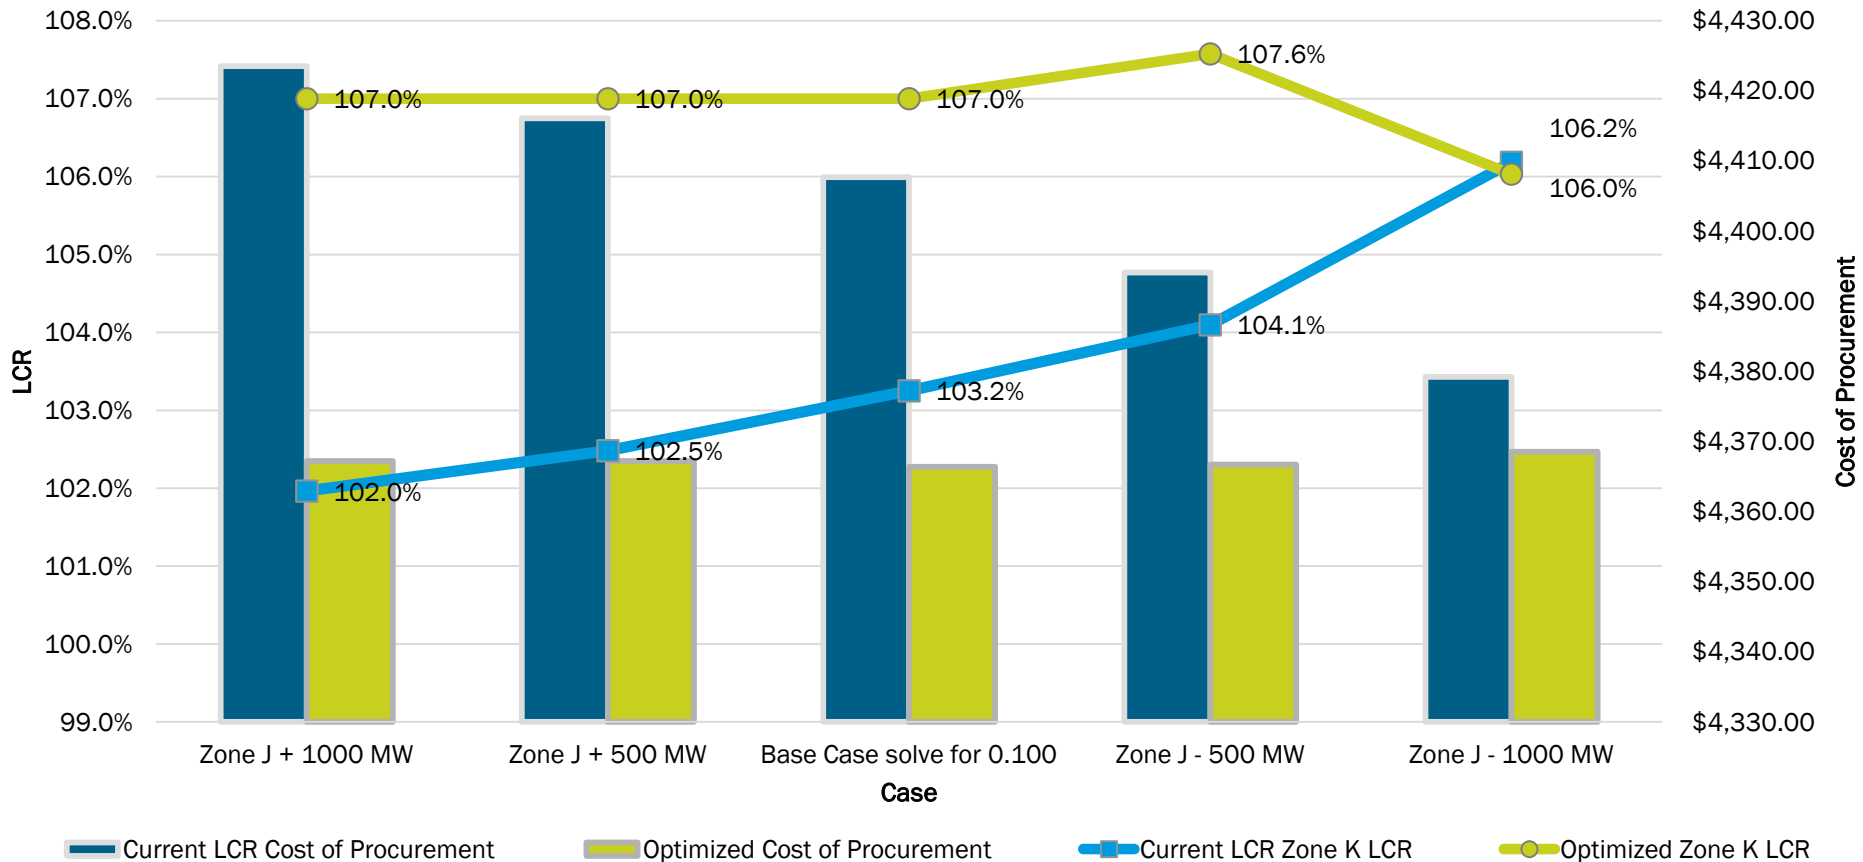

# Changes to Capacity in J: GHIJ LCR

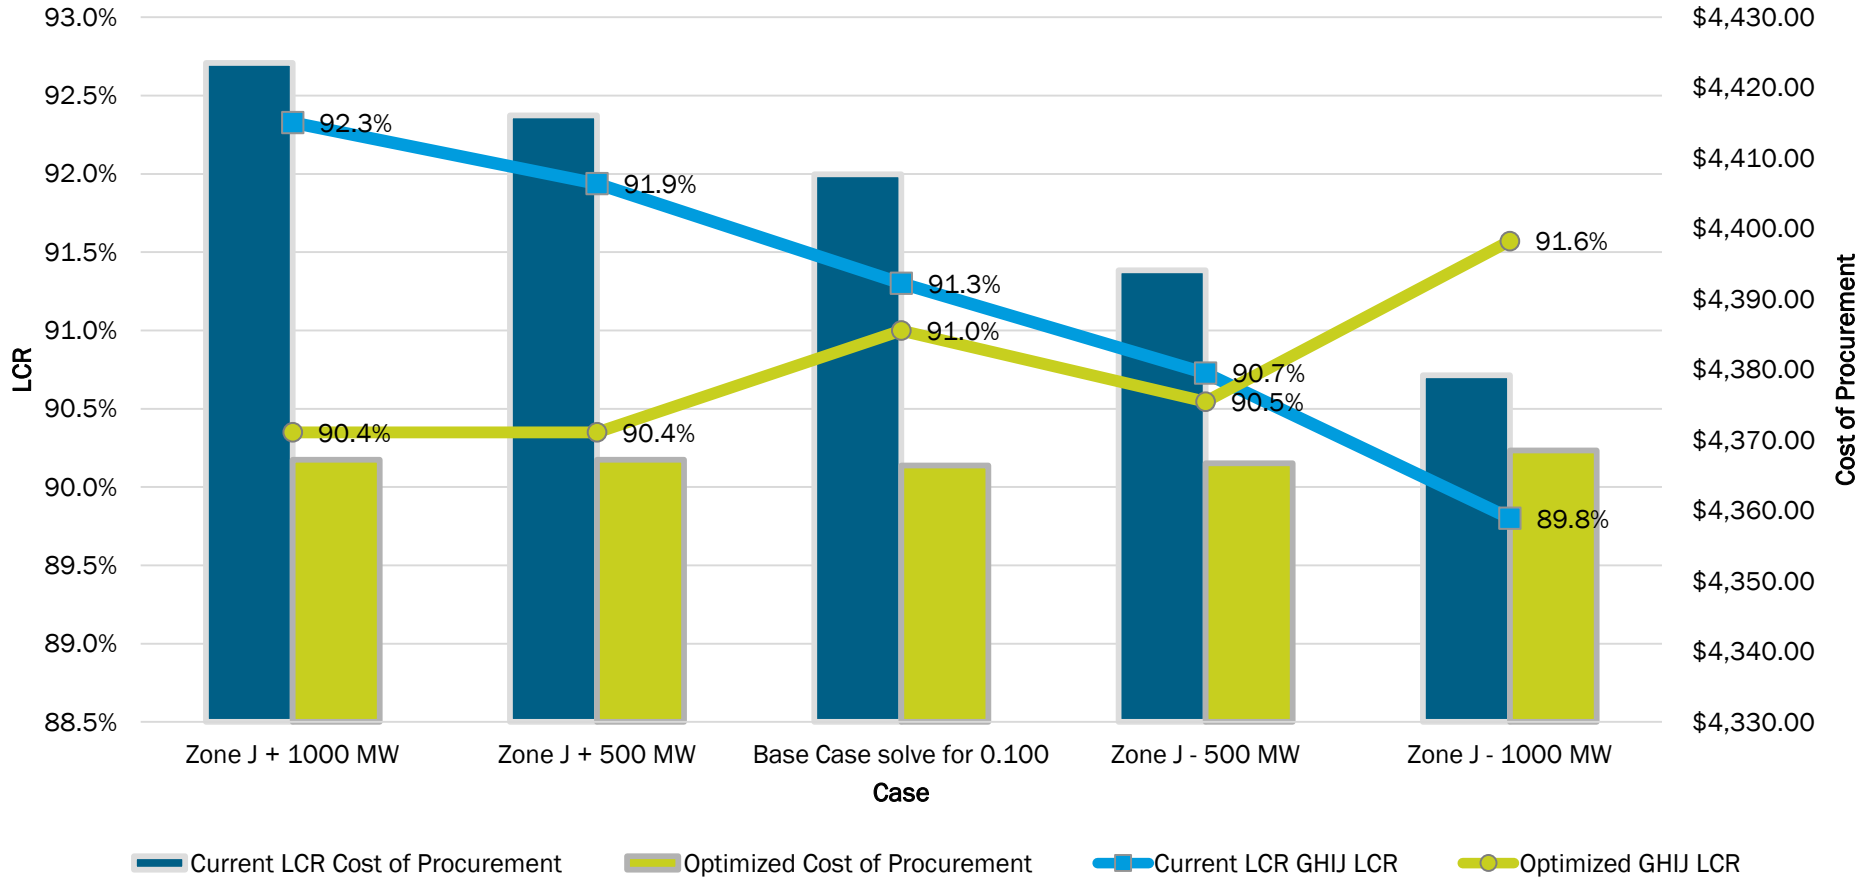


# Changes to Capacity in K: Zone J LCR

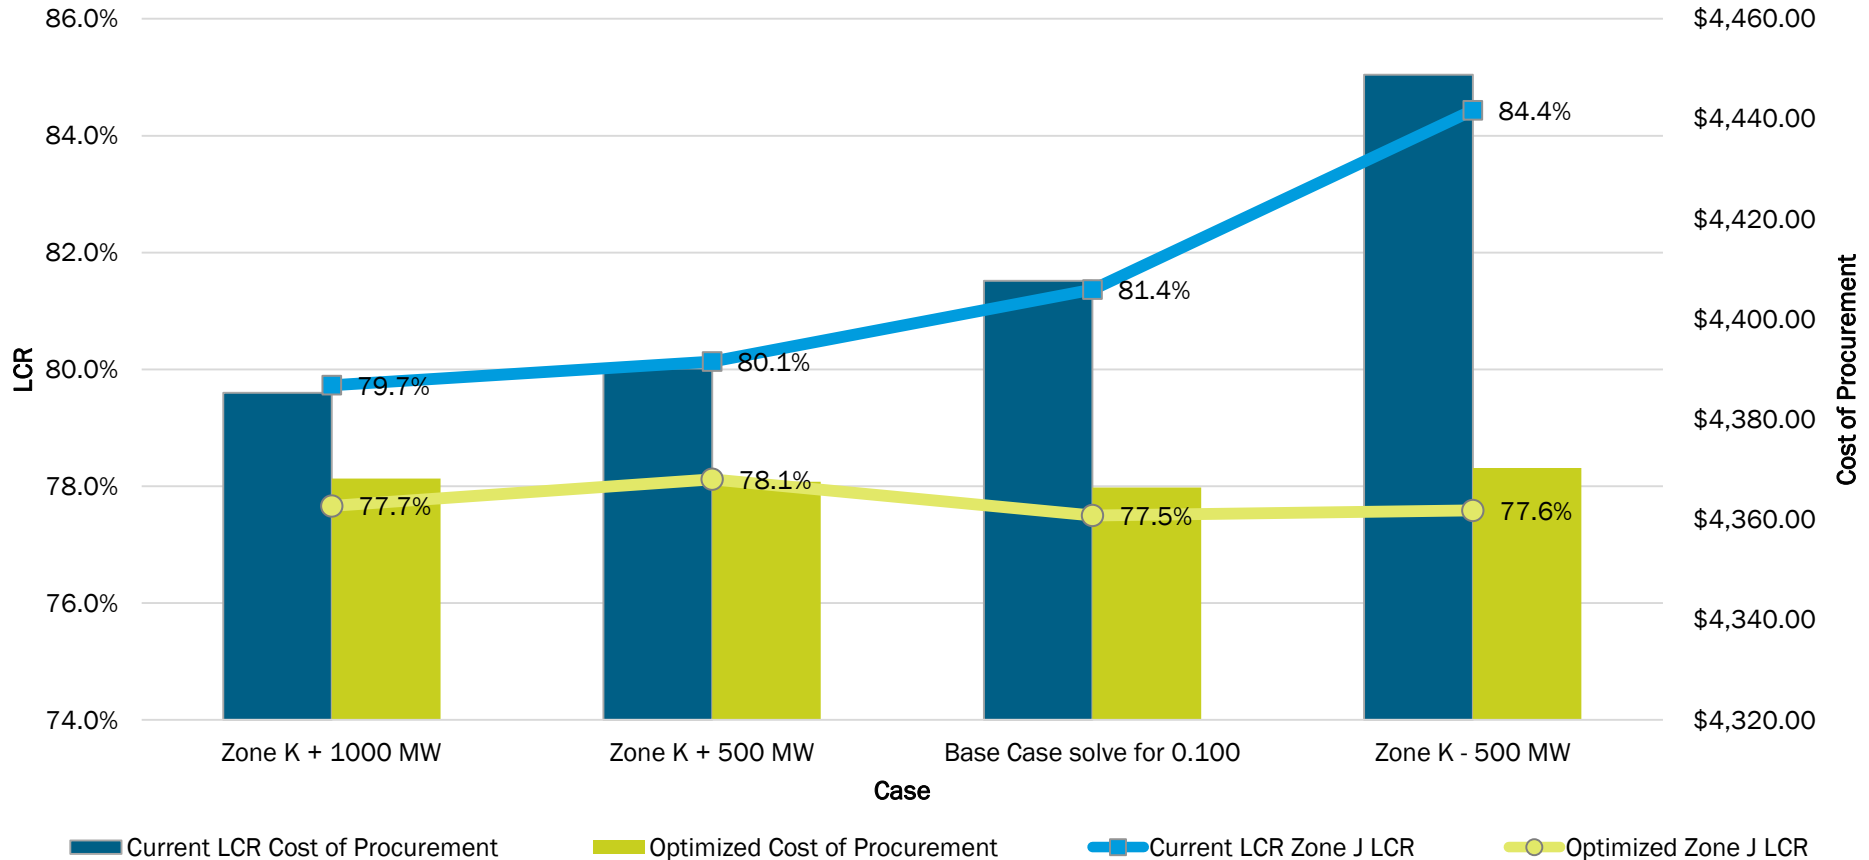





# Changes to Capacity in K: Zone K LCR

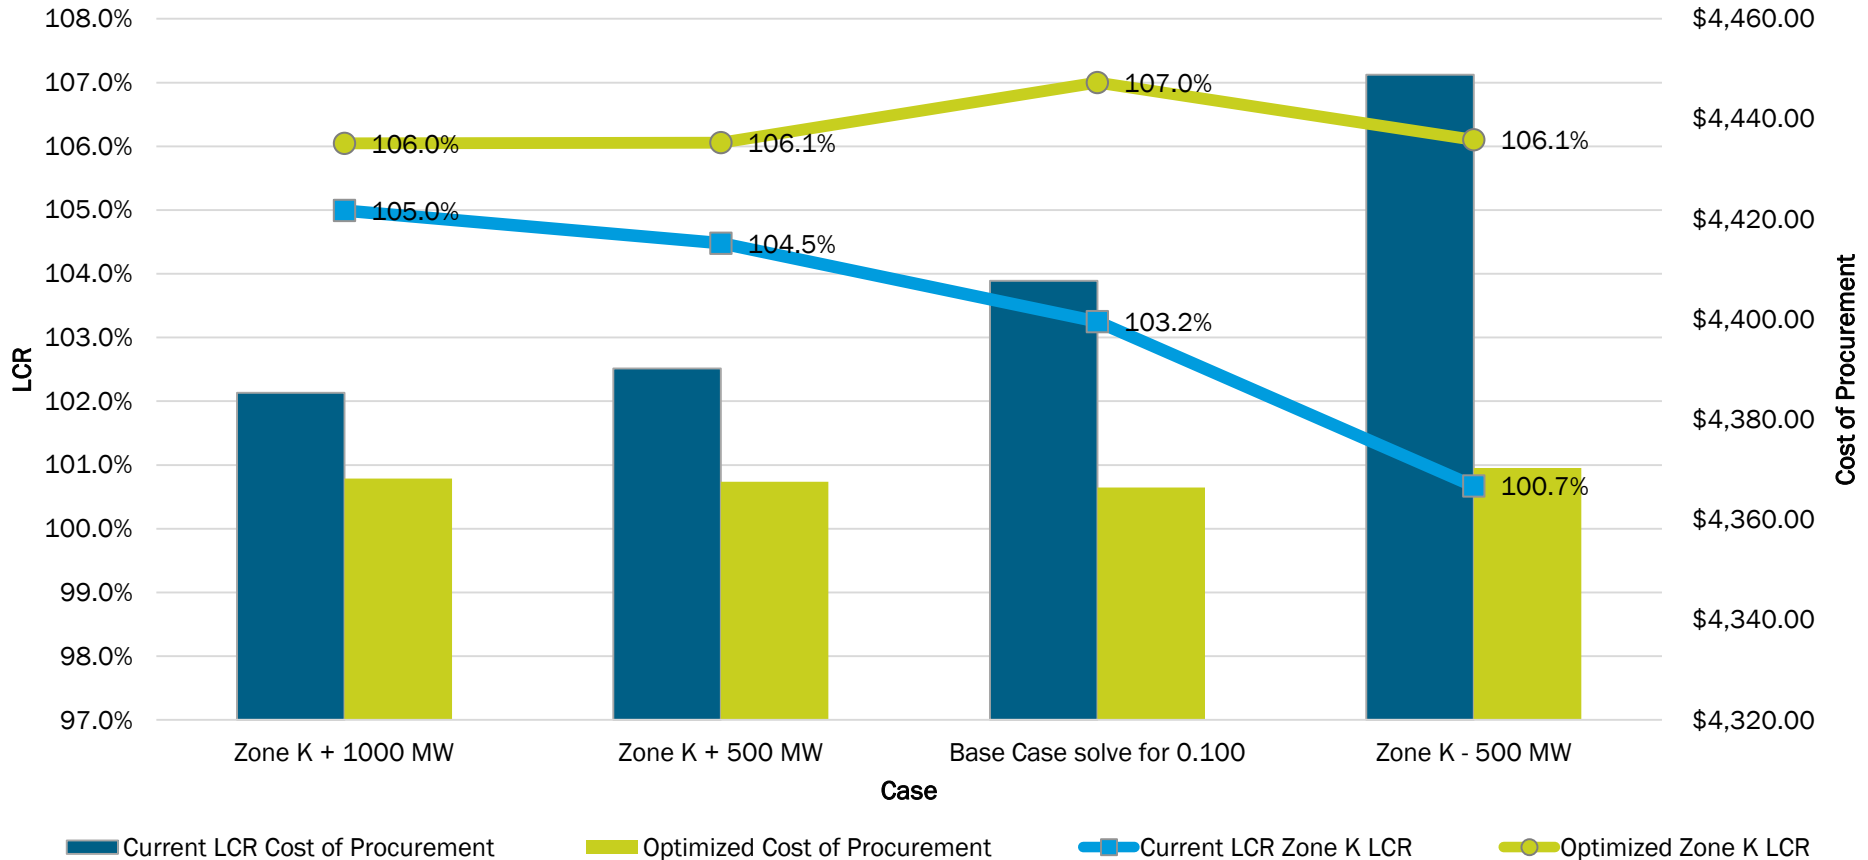


# Changes to Capacity in K: GHIJ LCR

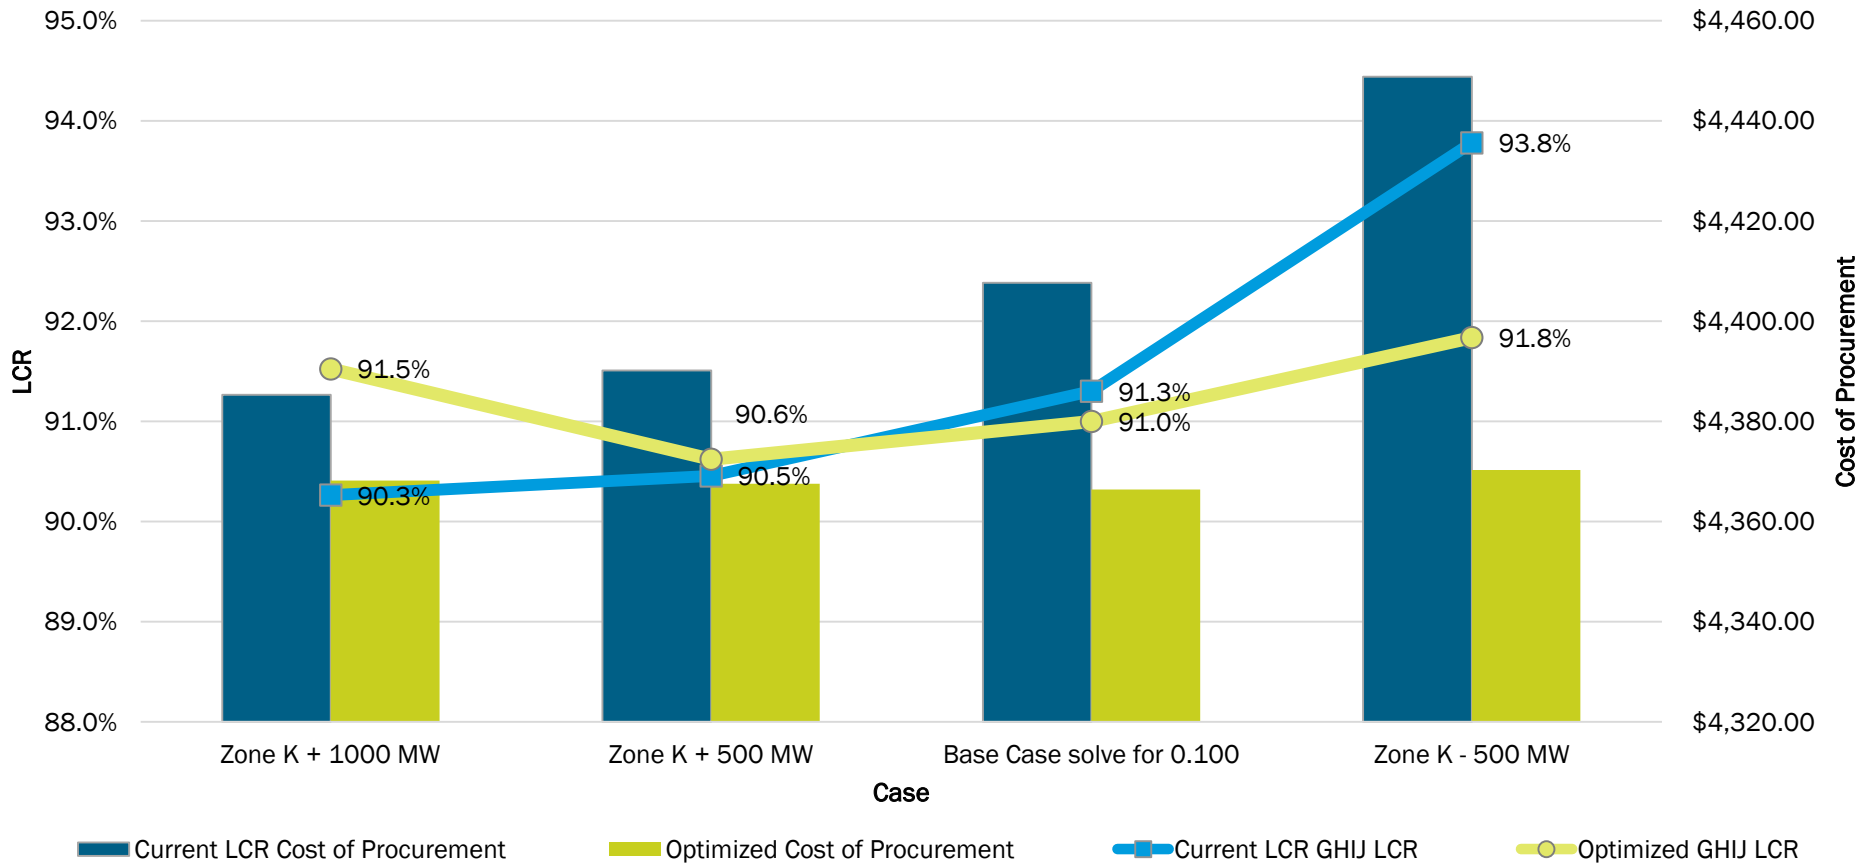


# Changes to Capacity in ROS: Zone J LCR

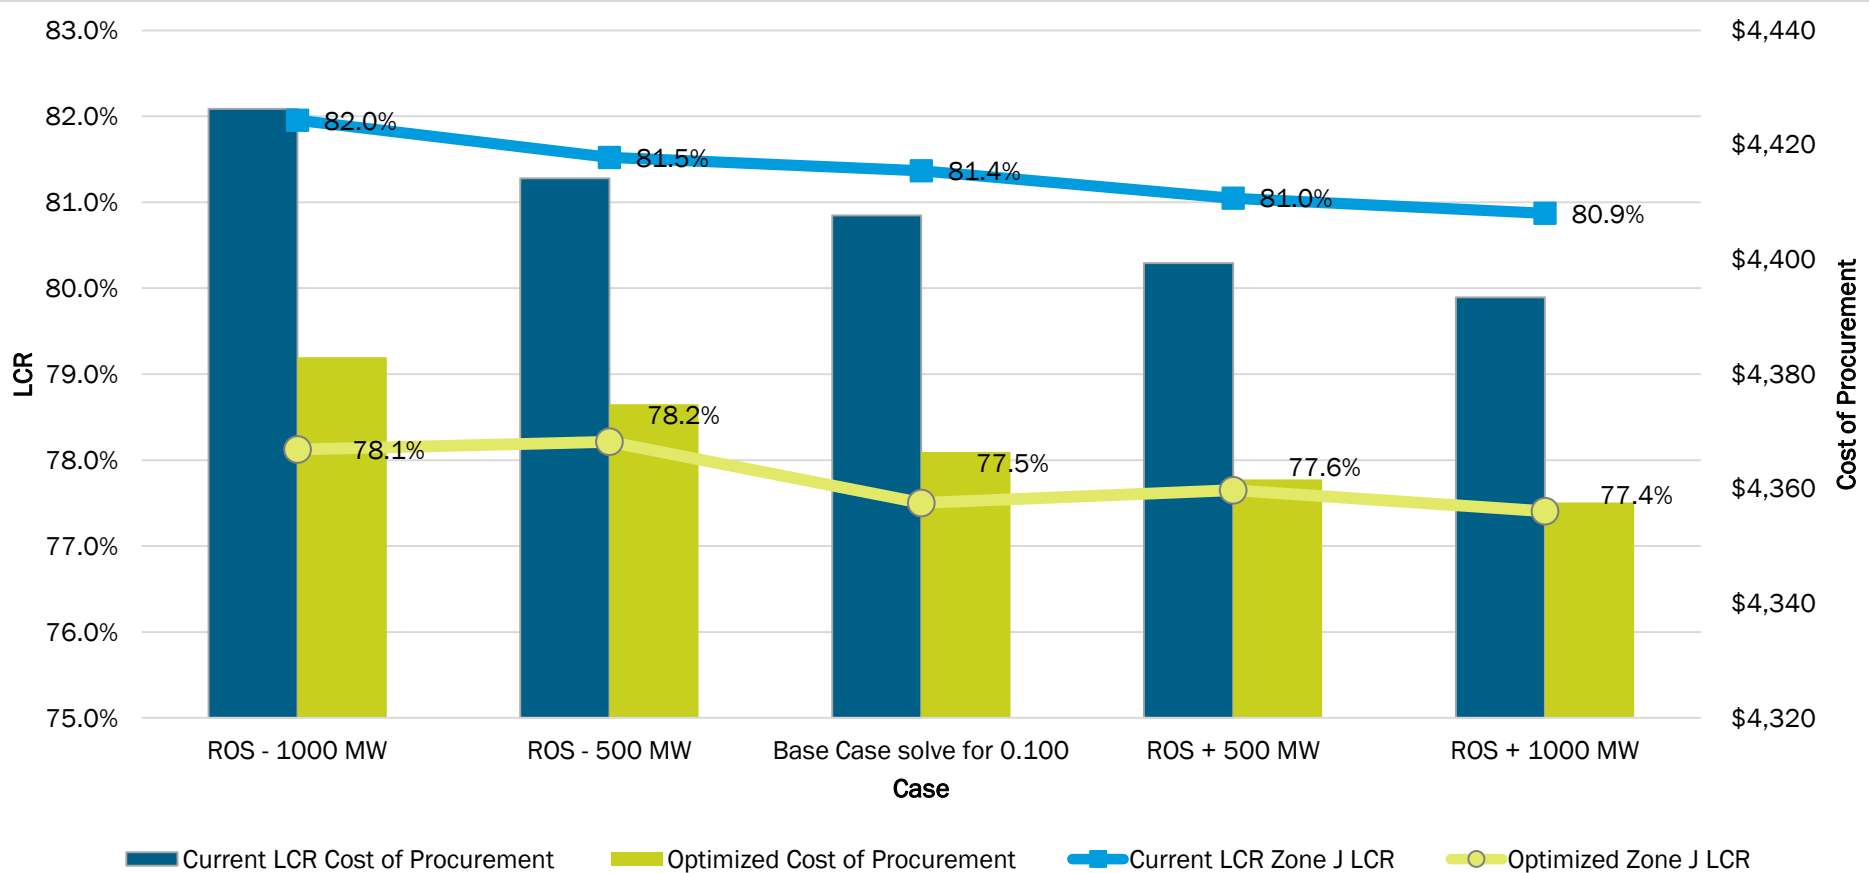

# Changes to Capacity in ROS: Zone K LCR

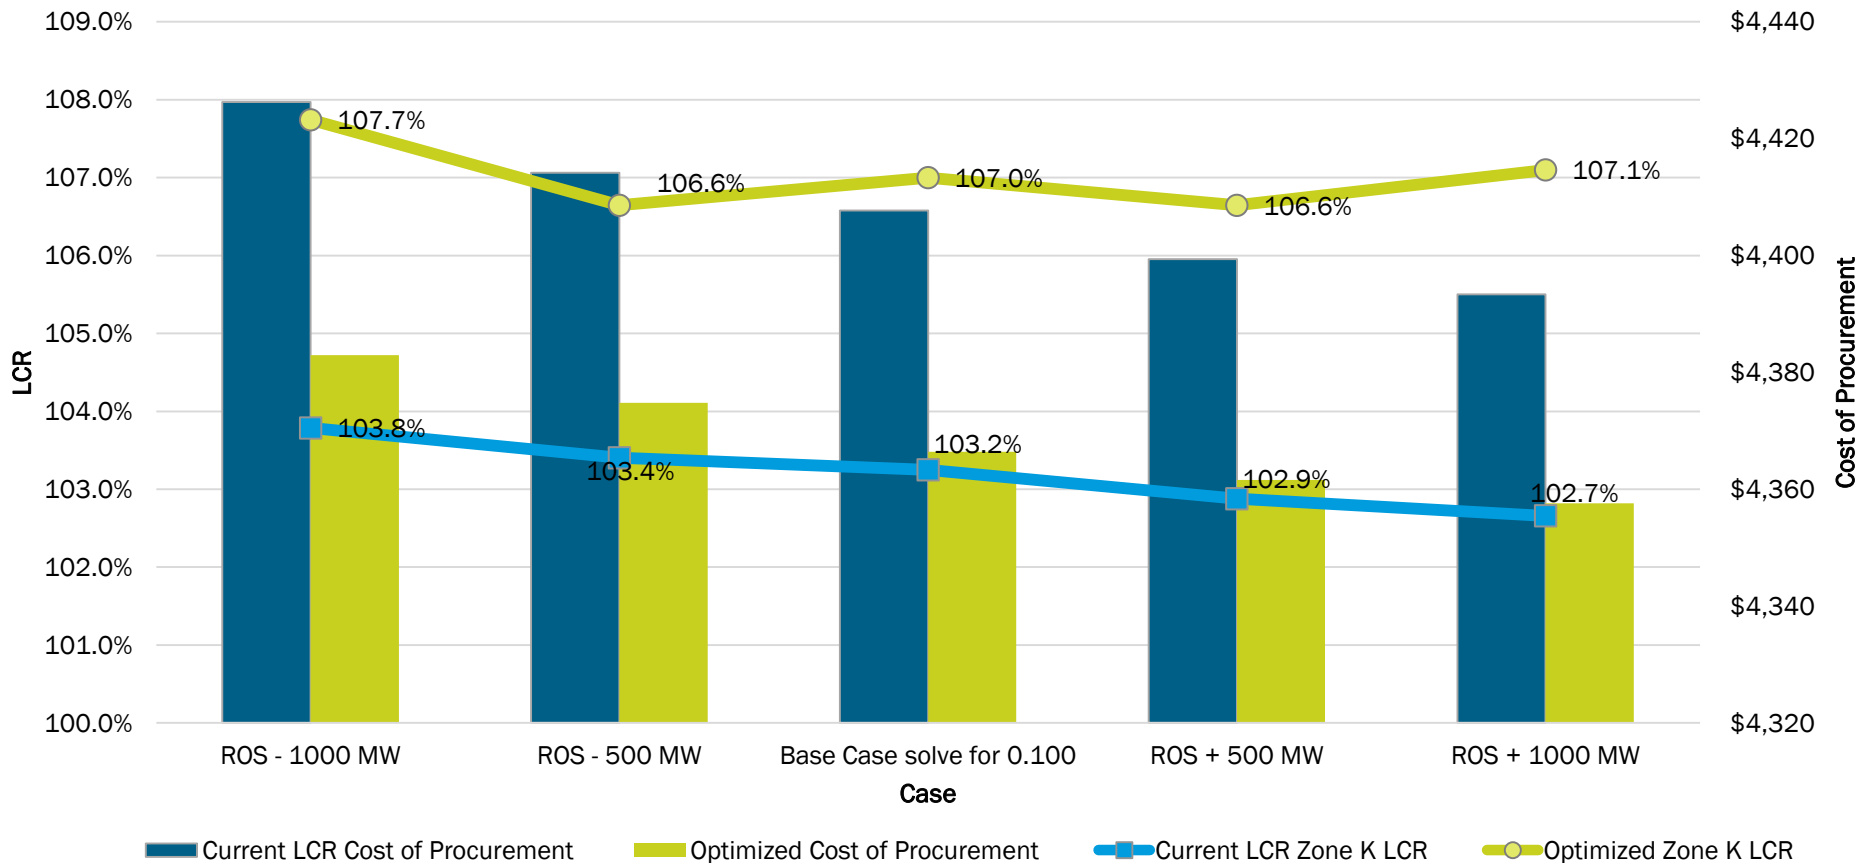

# Changes to Capacity in ROS: GHJ LCR

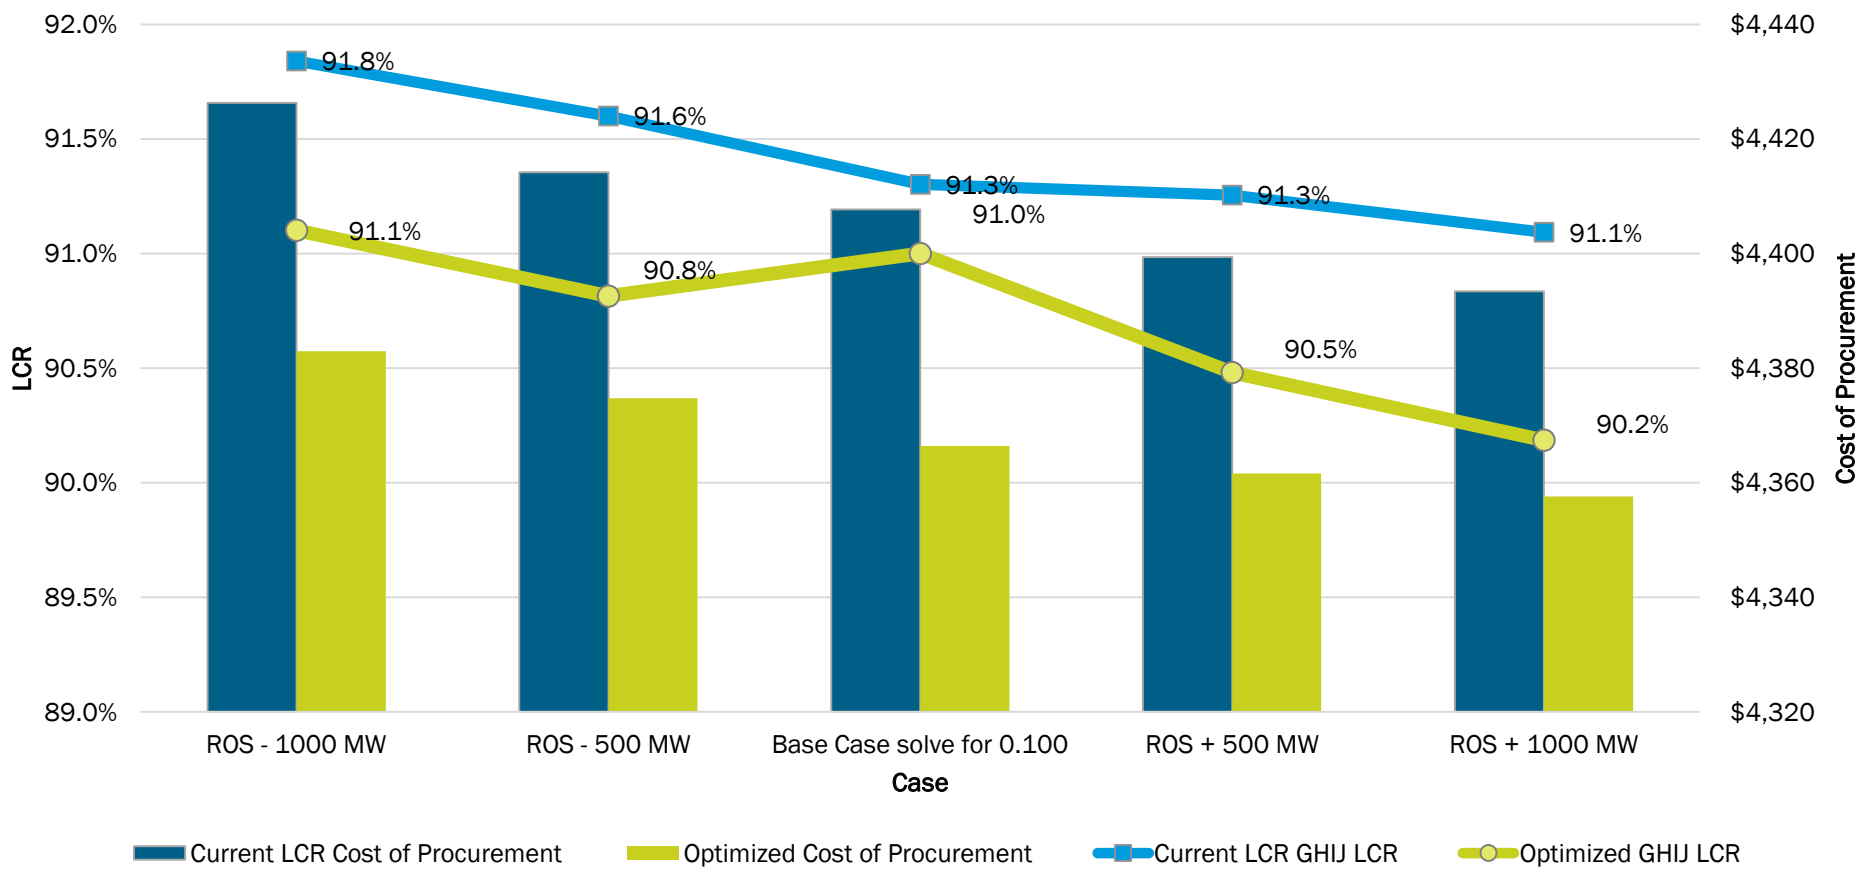

# Changes in Capacity: Comparative Results

| Scenario                            | Δ Optimized LCR from Optimized Base Case (%) |            |            | Δ Current LCR case from Current LCR Base Case (%) |            |            |
|-------------------------------------|--|------------|------------|---|------------|------------|
|                                     | Zone J                                       | Zone K     | G-J        | Zone J  | Zone K     | G-J        |
| +500 MW in GHIJ                     | 0.2  | 0.7        | 0.1        | -1.3  | -0.5       | 2.3        |
| - 500 MW in GHIJ                    | 0.0  | 0.5        | -1.0       | 1.6   | 0.6        | -1.7       |
| +500 MW in J                        | 0.4  | 0.0        | -0.6       | 0.5   | -0.7       | 0.6        |
| -500 MW in J                        | 0.1  | 0.6        | -0.5       | -1.0  | 0.9        | -0.6       |
| +500 MW in K                        | 0.6  | -0.9       | -0.4       | -1.3  | 1.3        | -0.8       |
| -500 MW in K                        | 0.1  | -0.9       | 0.8        | 3.0   | -2.5       | 2.5        |
| +500 MW in ROS                      | 0.1  | -0.4       | -0.5       | -0.4  | -0.3       | -0.0       |
| -500 MW in ROS                      | 0.7  | -0.4       | -0.2       | 0.1   | 0.2        | 0.3        |
| <b>Average Absolute Δ from Base</b> | <b>0.3</b>                                   | <b>0.6</b> | <b>0.5</b> | <b>1.2</b>  | <b>0.9</b> | <b>1.1</b> |

# Changes in Capacity: Comparative Results

| Scenario                            | Δ Optimized LCR from Optimized Base Case (%) |            |            | Δ Current LCR case from Current LCR Base Case (%) |            |            |
|-------------------------------------|--|------------|------------|---|------------|------------|
|                                     | Zone J                                       | Zone K     | G-J        | Zone J  | Zone K     | G-J        |
| +1000 MW in GHIJ                    | 0.4  | 0.9        | 0.5        | -1.5  | -0.8       | 5.5        |
| -1000 MW in GHIJ                    | -0.5   | 0.2        | -1.0       | 3.9   | 1.7        | -3.3       |
| +1000 MW in J                       | 0.4  | 0.0        | -0.6       | 1.1   | -1.2       | 1.0        |
| -1000 MW in J                       | 0.2  | -1.0       | 0.6        | -2.2  | 3.0        | -1.5       |
| +1000 MW in K                       | 0.2  | -1.0       | 0.5        | -1.7  | 1.8        | -1.0       |
| +1000 MW in ROS                     | -0.1   | 0.1        | -0.8       | -0.5  | -0.5       | -0.2       |
| -1000 MW in ROS                     | 0.6  | 0.7        | 0.1        | 0.6   | 0.6        | 0.5        |
| <b>Average Absolute Δ from Base</b> | <b>0.3</b>                                   | <b>0.6</b> | <b>0.6</b> | <b>1.6</b>  | <b>1.4</b> | <b>1.9</b> |

# Changes in Capacity: Cost Comparison

| Scenario        | Current LCR Methodology Cost (million) | Optimized LCR Methodology Cost (million) | Δ Cost (million) |
|-----------------|--|--|------------------|
| Base Case       | \$4,407.7                              | \$4,366.4                                | \$41.3           |
| GHIJ + 500 MW   | \$4,406.0                              | \$4,374.6                                | \$31.4           |
| GHIJ - 500 MW   | \$4,422.2                              | \$4,359.8                                | \$62.4           |
| Zone J + 500 MW | \$4,416.0                              | \$4,367.2                                | \$48.9           |
| Zone J - 500 MW | \$4,394.1                              | \$4,366.7                                | \$27.4           |
| Zone K + 500 MW | \$4,390.2                              | \$4,367.6                                | \$22.6           |
| Zone K - 500 MW | \$4,448.8                              | \$4,370.3                                | \$78.5           |
| ROS + 500 MW    | \$4,399.4                              | \$4,361.6                                | \$37.7           |
| ROS - 500 MW    | \$4,414.2                              | \$4,374.8                                | \$39.4           |

- Cost presented is the solution cost from the optimization objective function
- The objective function represents the cost of capacity procurement at the given requirement



# Changes in Capacity: Cost Comparison


| Scenario         | Current LCR Methodology Cost (million) | Optimized LCR Methodology Cost (million) | Δ Cost (million) |
|------------------|--|--|------------------|
| Base Case        | \$4,407.7                              | \$4,366.4                                | \$41.3           |
| GHIJ + 1000 MW   | \$4,430.2                              | \$4,383.5                                | \$46.7           |
| GHIJ - 1000 MW   | \$4,443.8                              | \$4,350.4                                | \$93.4           |
| Zone J + 1000 MW | \$4,423.5                              | \$4,367.2                                | \$56.3           |
| Zone J - 1000 MW | \$4,379.2                              | \$4,368.5                                | \$10.7           |
| Zone K + 1000 MW | \$4,385.3                              | \$4,368.2                                | \$17.1           |
| ROS + 1000 MW    | \$4,393.4                              | \$4,357.6                                | \$35.8           |
| ROS - 1000 MW    | \$4,426.3                              | \$4,383.0                                | \$43.3           |

# Changes in Capacity: Conclusions


- The optimized methodology reduces volatility in comparison to the current LCR methodology when there are changes in capacity
- Secondary effects observed in the optimization will be investigated in Phase 2

# Changes in Net CONE Sensitivities


# Net CONE Curves: +/- \$50 GHIJ

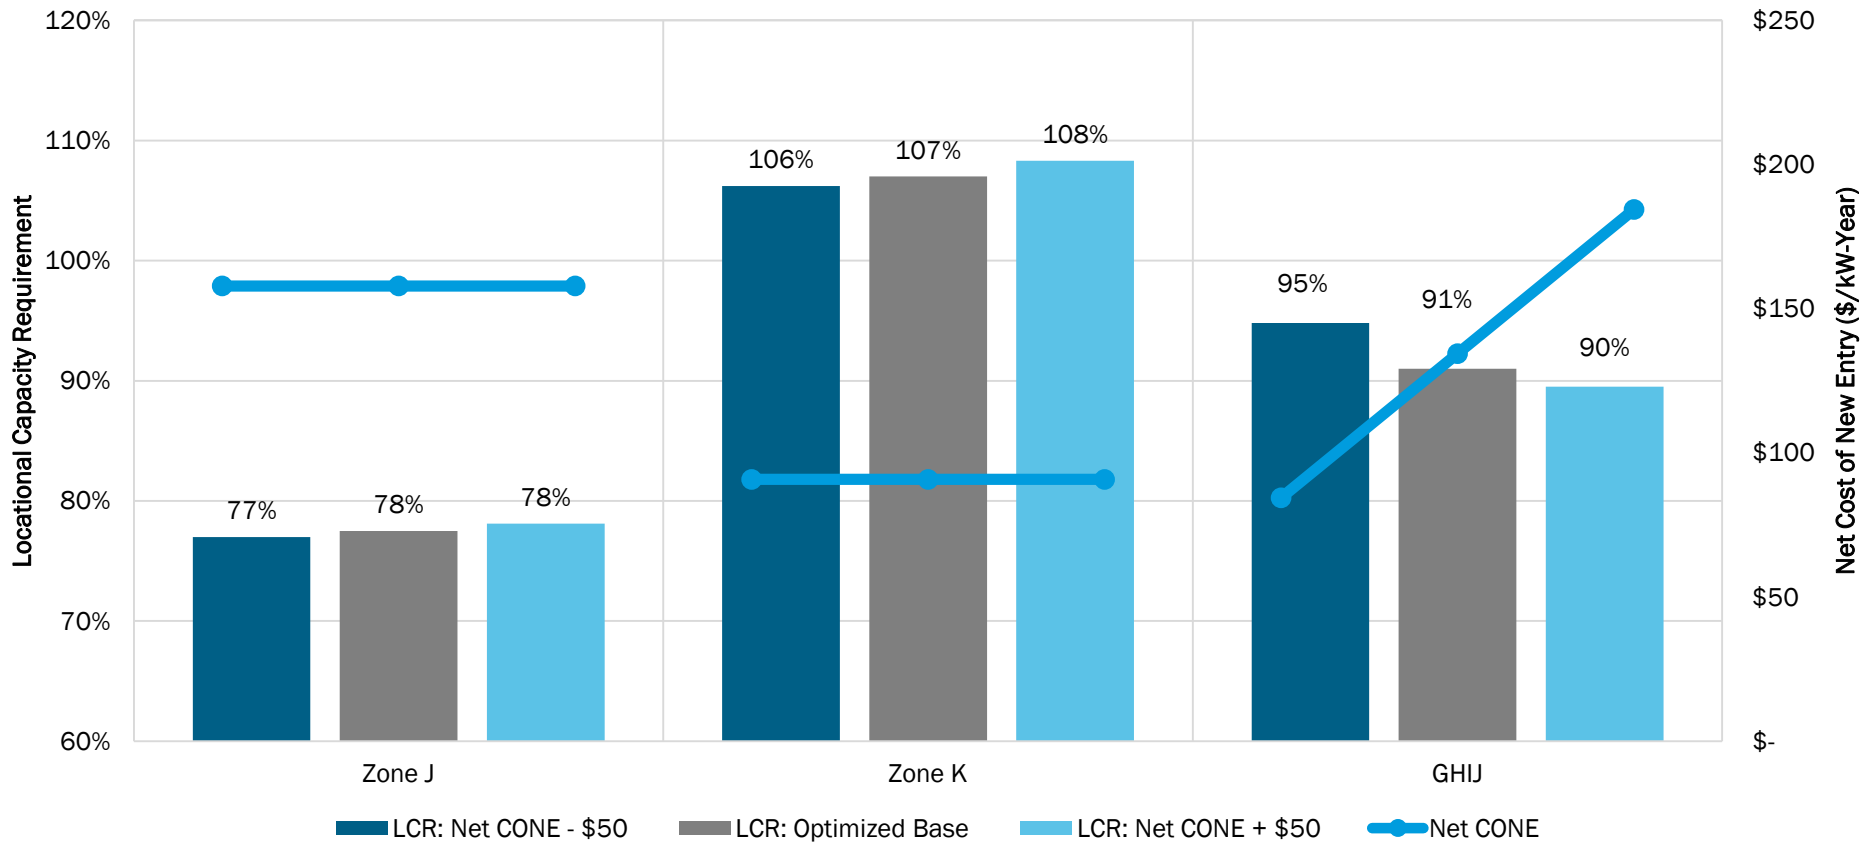


# Net CONE Curves: +/- \$50 Zone J

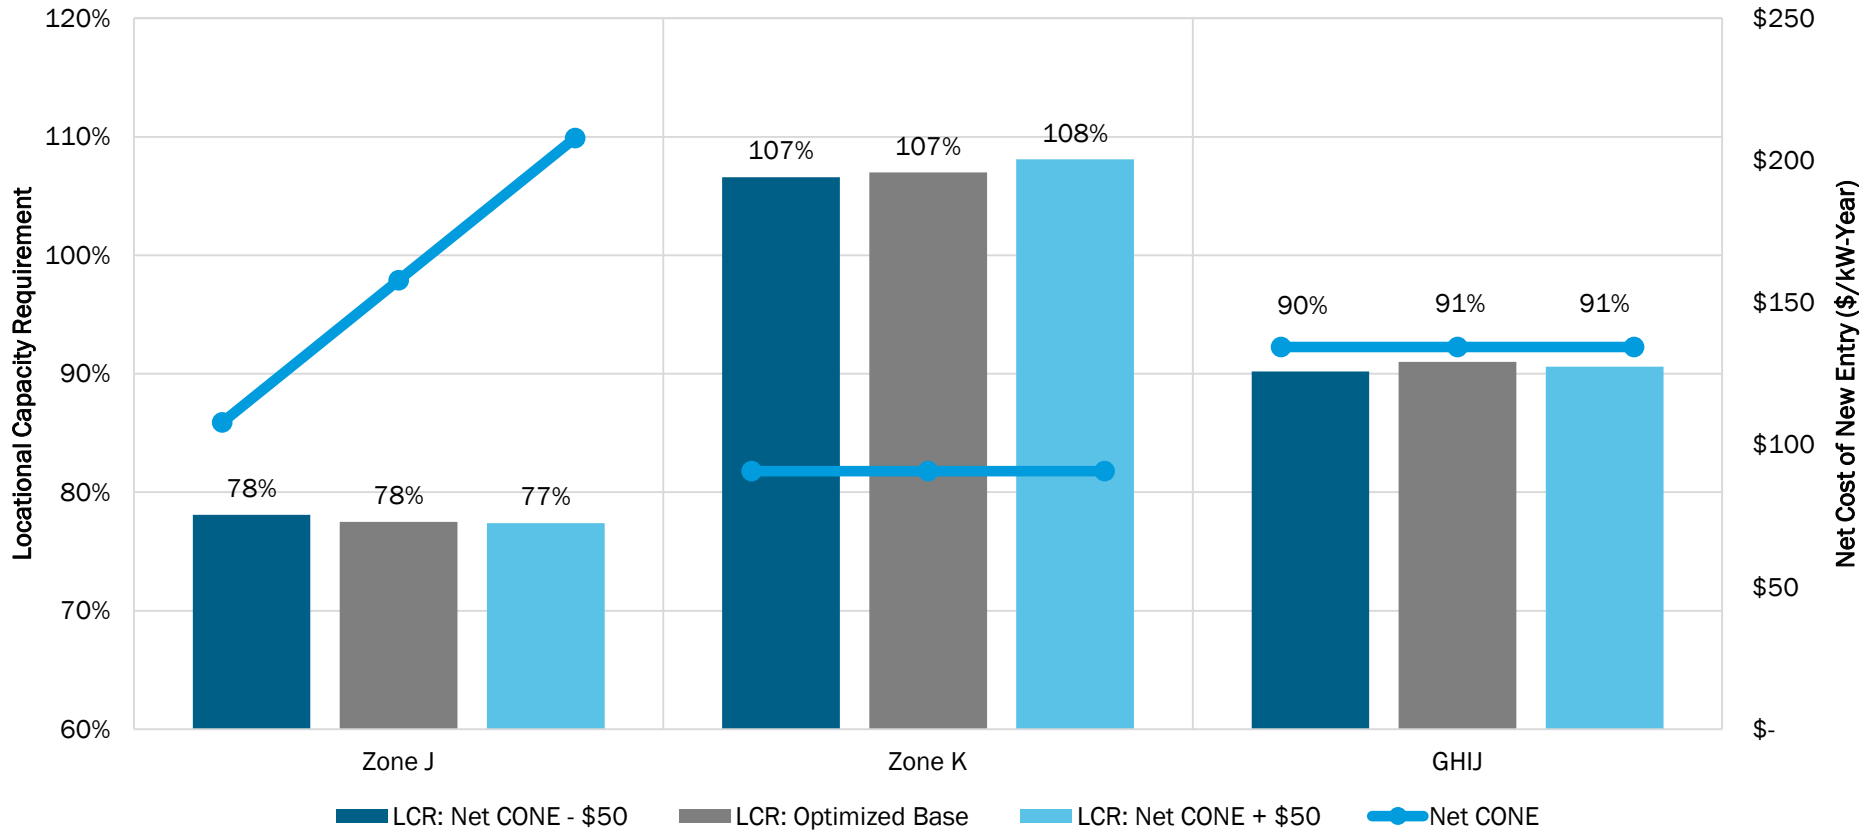


# Net CONE Curves: +/- \$50 Zone K

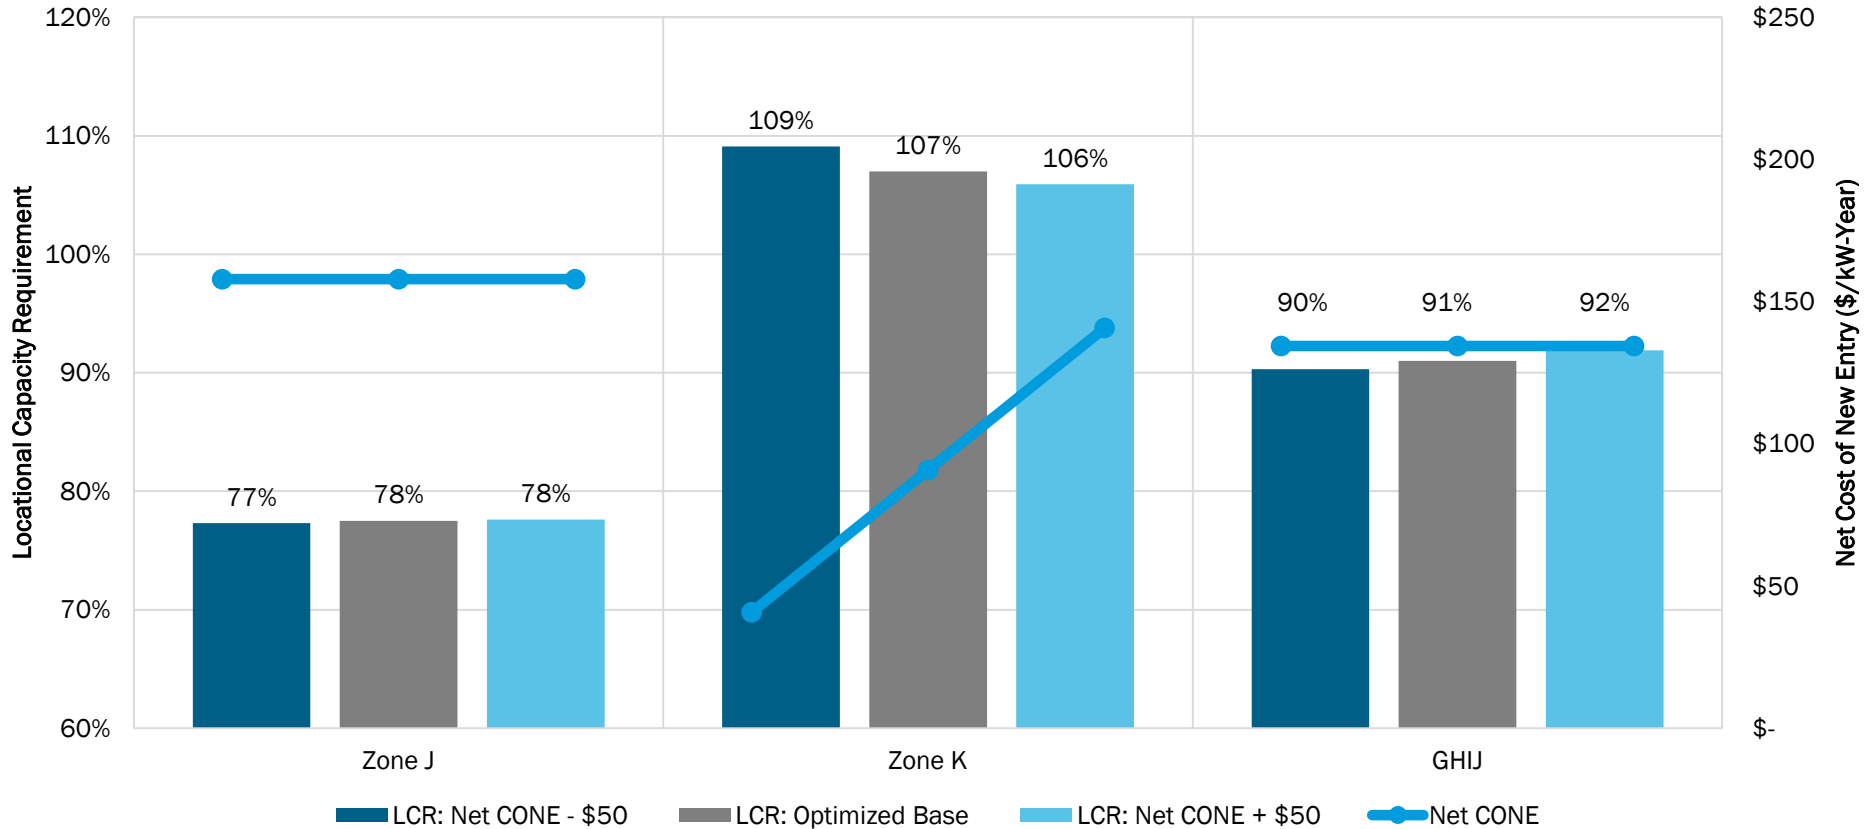

# Net CONE Curves: +/- \$50 NYCA

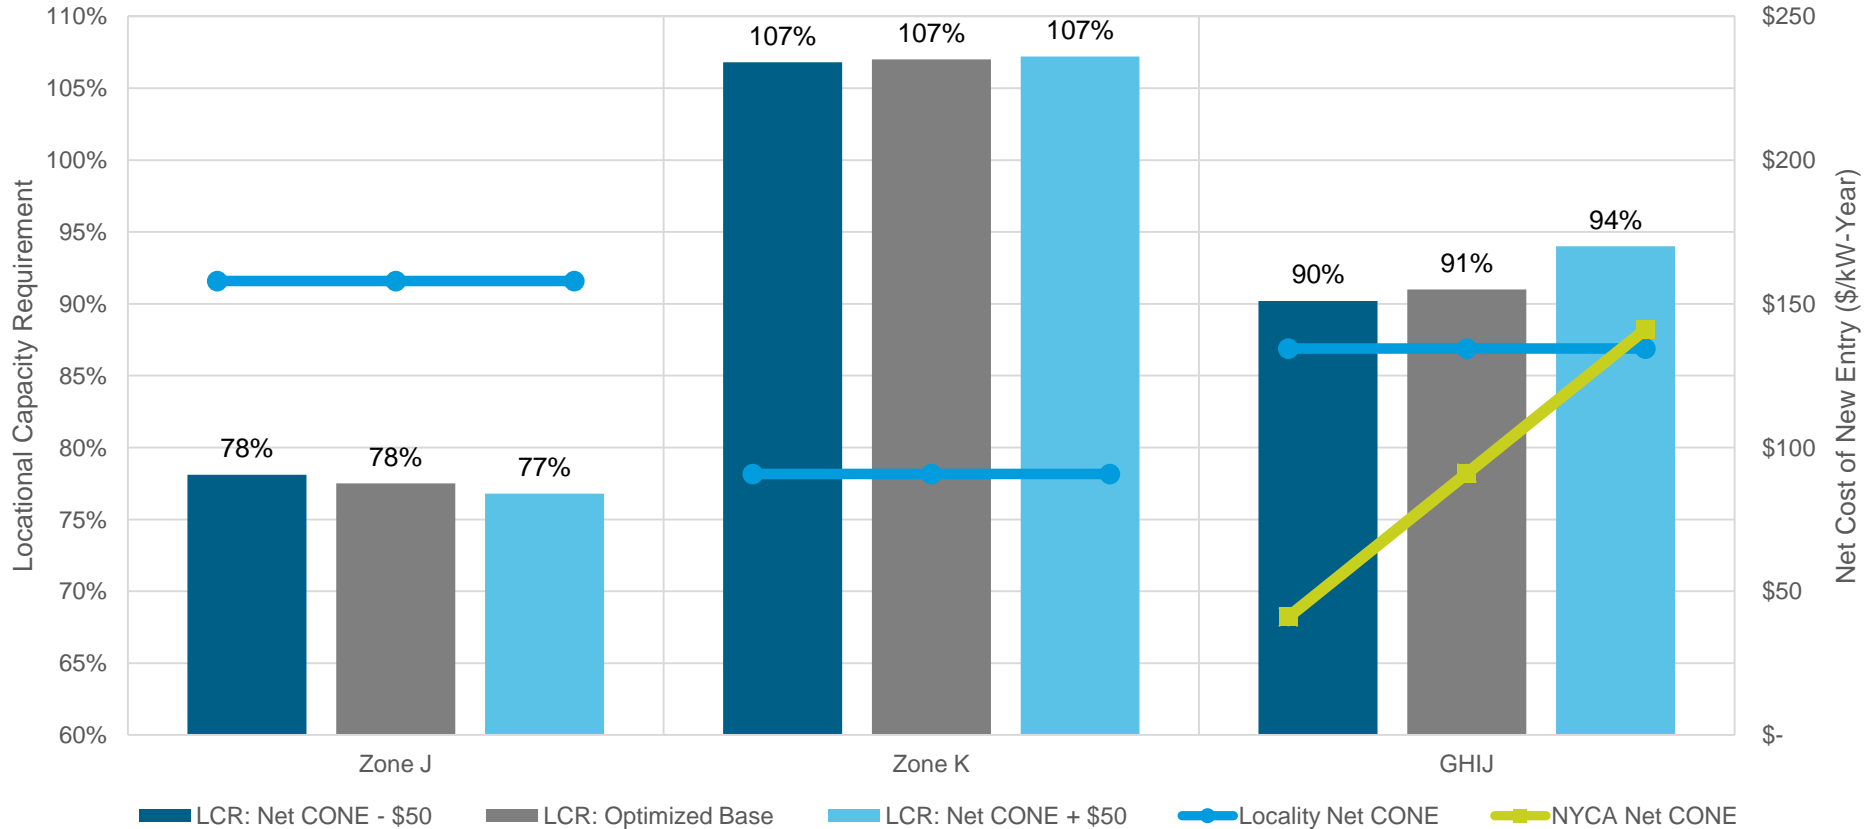

# Net CONE Curves: +\$50 All Zones

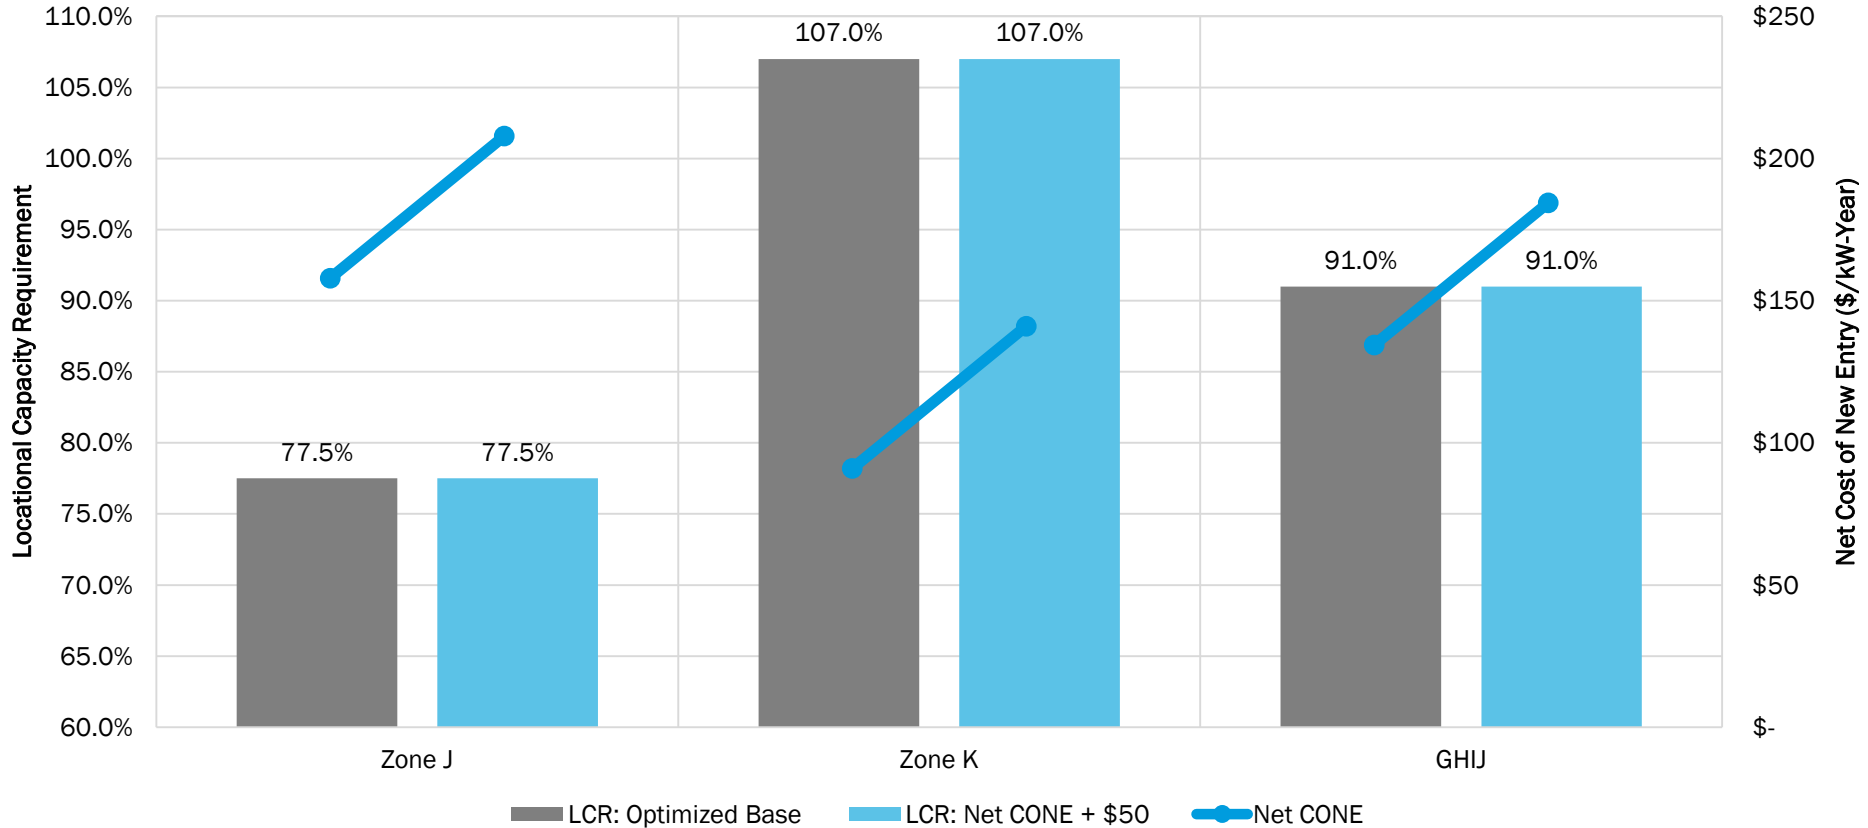



# Changes in Net CONE: Cost Comparison


| Scenario               | Current LCR Methodology Cost (million) | Optimized LCR Methodology Cost (million) | Δ Cost (million) |
|------------------------|--|--|------------------|
| Base Case              | \$4,413.7                              | \$4,366.4                                | \$47.3           |
| GHIJ Net CONE + \$50   | \$5,148.5                              | \$5,090.3                                | \$58.2           |
| GHIJ Net CONE - \$50   | \$4,154.4                              | \$4,079.8                                | \$74.6           |
| Zone J Net CONE + \$50 | \$4,889.3                              | \$4,818.7                                | \$70.6           |
| Zone J Net CONE - \$50 | \$3,938.1                              | \$3,911.8                                | \$26.3           |
| Zone K Net CONE + \$50 | \$5,170.1                              | \$5,109.2                                | \$60.9           |
| Zone K Net CONE - \$50 | \$4,132.8                              | \$4,073.7                                | \$59.1           |
| NYCA Net CONE + \$50   | \$5,831.1                              | \$5,747.2                                | \$83.9           |
| NYCA Net CONE - \$50   | \$3,471.9                              | \$3,424.9                                | \$47.0           |
| All Net CONE + \$50    | \$6,371.2                              | \$6,323.9                                | \$47.3           |

# Changes in Net CONE: Conclusions

- The sensitivities tested extreme changes (i.e., between 30% and 55% change in Net CONE)
- The optimized LCR responded intuitively to the changes in Net CONE (i.e., increase in Net CONE in most instances causes a reduction in LCR)
- The Net CONE can have an impact on the final optimized LCRs
- This places an emphasis on developing robust methodology for determining the cost curves

# Changes in Transmission Sensitivities

# Changes in Transmission: Optimized Methodology

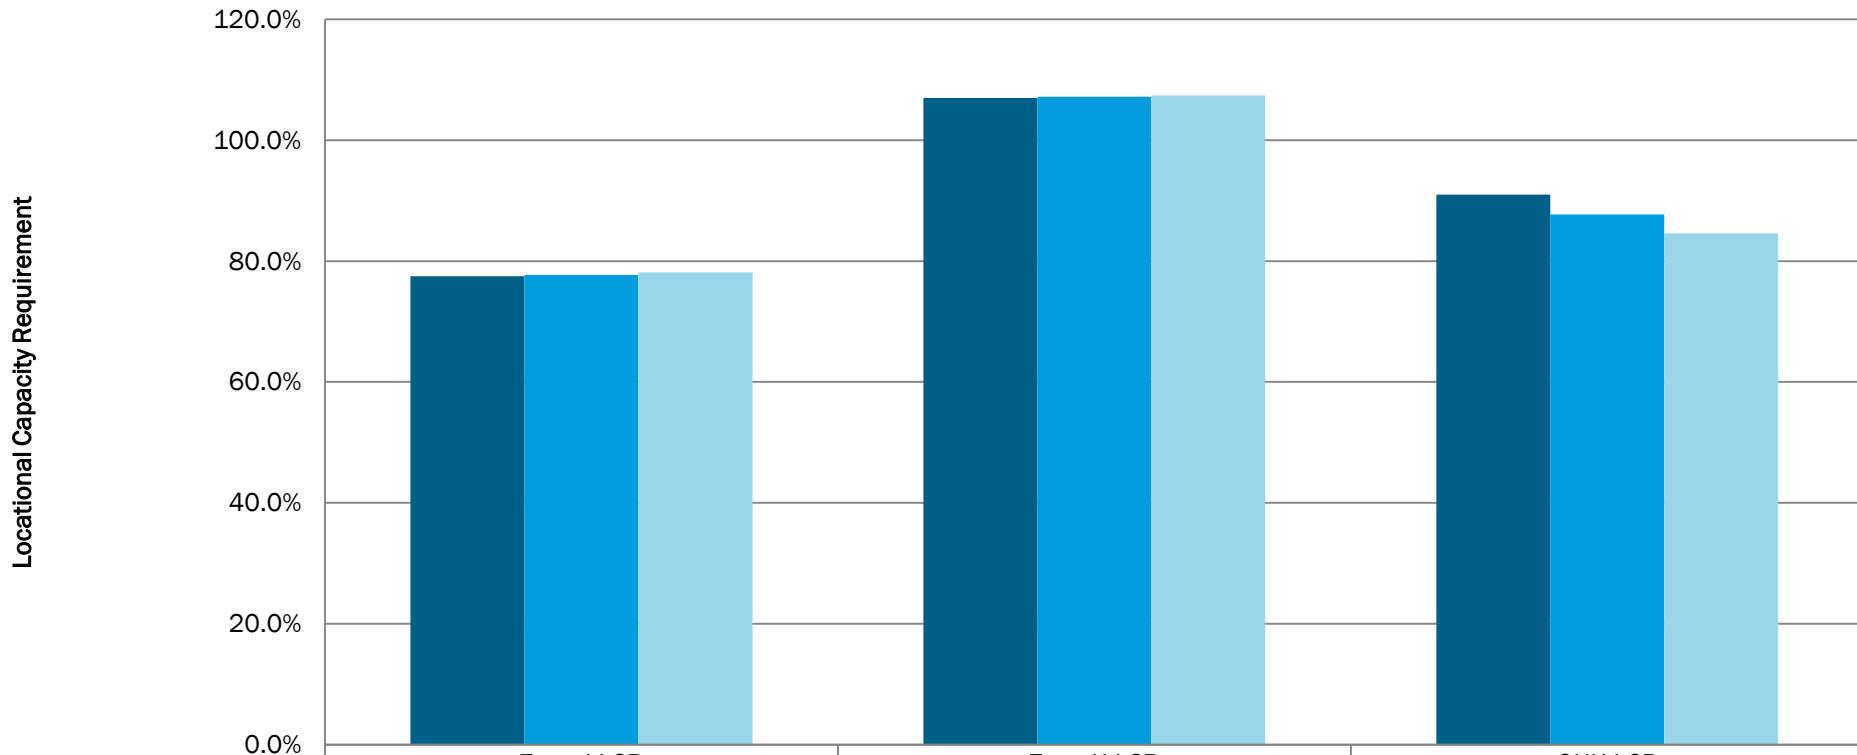

■ Base Case

■ UPNY-SENY + 500 MW

■ UPNY-SENY + 1000 MW

Zone J LCR

77.5%

77.7%

78.1%

Zone K LCR

107.0%

107.2%

107.4%


GHIJ LCR

91.0%

87.7%

84.6%

# Changes in Transmission: Current Methodology

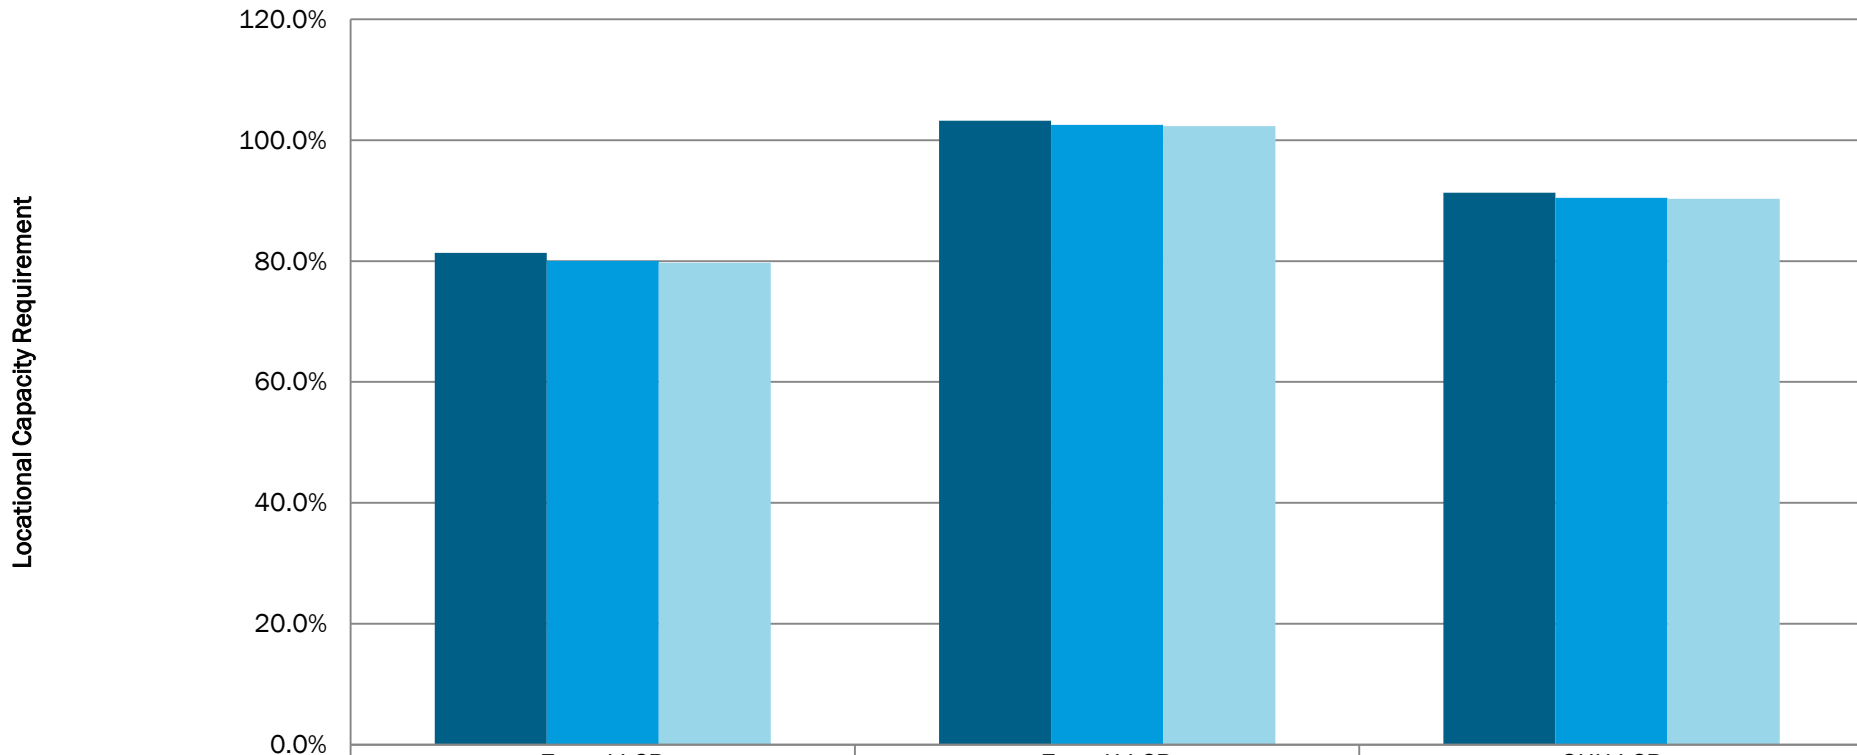

|                             |       |        |       |
|-----------------------------|-------|--------|-------|
| ■ Base Case solve for 0.100 | 81.4% | 103.2% | 91.3% |
| ■ UPNY-SENY + 500 MW        | 80.0% | 102.5% | 90.5% |
| ■ UPNY-SENY + 1000 MW       | 79.7% | 102.3% | 90.3% |

# Changes in Transmission: Conclusions of Simple Analysis

- There are limitations to this simple analysis since changes in UPNY-SENY transmission would likely result in a change in the IRM
- The conclusions based on the simple analysis presently are:
  - UPNY-SENY reduces amount of optimal capacity required in GHJ, but does not impact the amount for Zone J
  - The Zone J LCR is minimized to its optimal level in the Base Case (as a result of constraints south of UPNY-SENY)
  - Future sensitivity will seek to confirm that the optimal Zone J LCR is dependent on the downstream constraints by increasing Dunwoodie South limit to observe if the optimal Zone J LCR decreases

# Phase 1: Conclusions and Next Steps

- Perform sensitivities to assist in the understanding of any secondary effects observed in changes in generation sensitivities
- Work to potentially refine methodology to address these secondary effects
- Develop a robust methodology for determining cost curves that minimizes volatility
- Run a full Tan45 process for a few specific sensitivities to increase the understanding of how the current process and optimization responds
- While cost savings are only 1-2%, the process has numerous other benefits
  - Stability, more robust, intuitive, etc.


# Phase 2: Refining Methodology



# Transmission Security

- The NYISO continues to work to develop values for the lower bounds
- Sensitivities were performed to show how the optimization could incorporate lower bounds
  - Incorporated an arbitrary lower bound for Zone J of 80%

# Changes in Generation: Optimized Methodology with Lower Bound

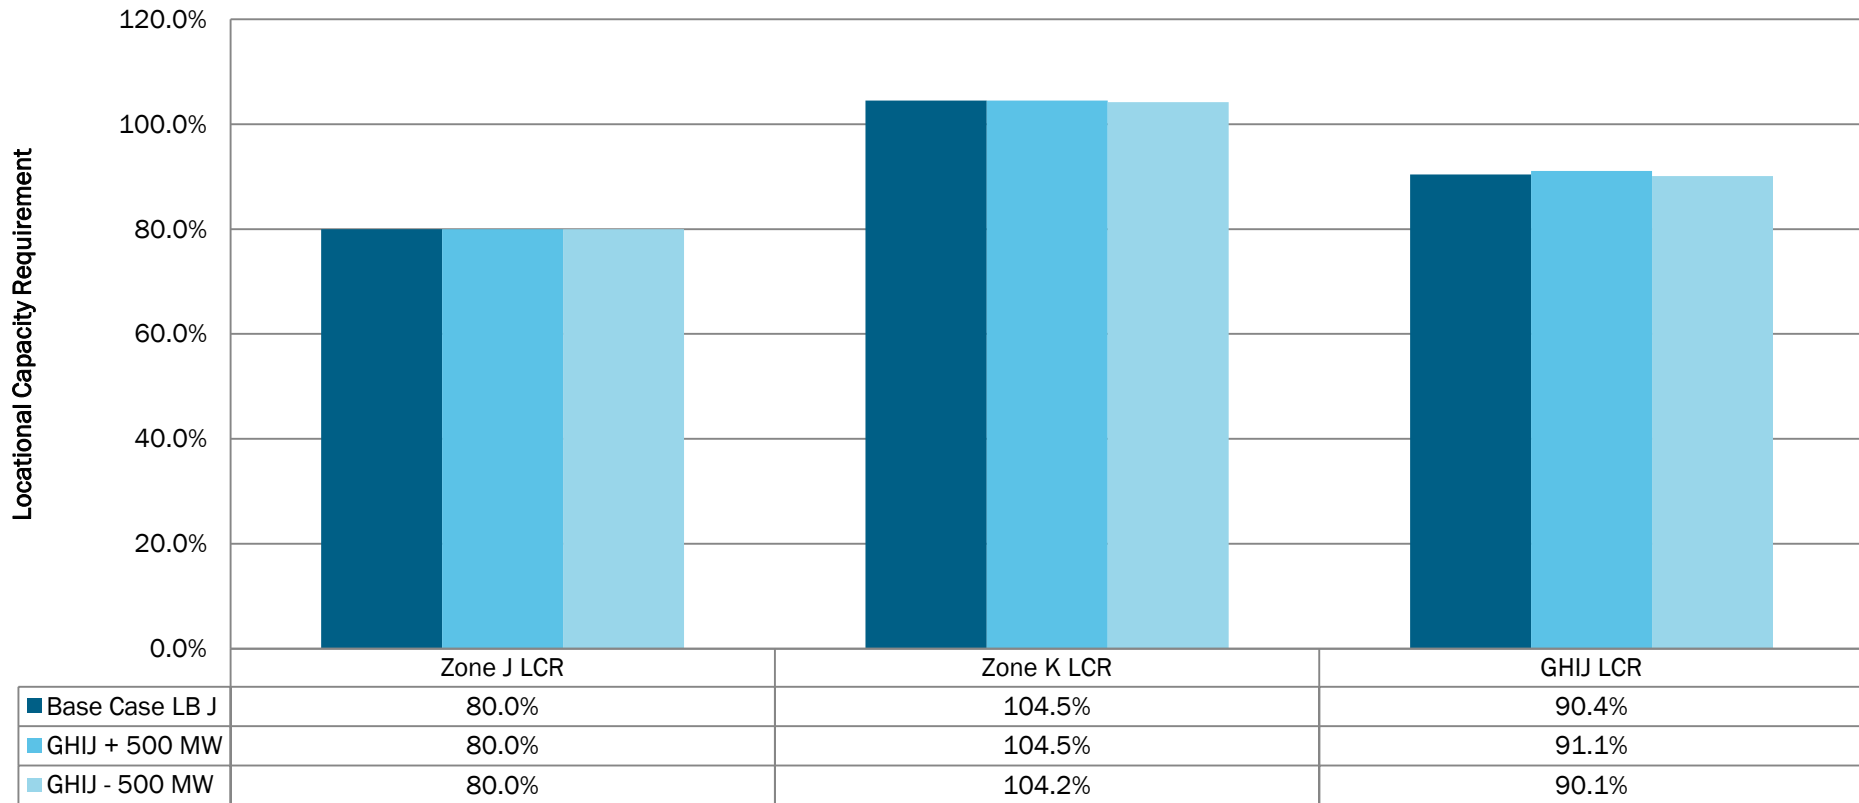

# Lower Bound Comparison of Costs

| Scenario        | Optimized LCR with Lower Bound Cost (million) | Current LCR Methodology Cost (million) | $\Delta$ Cost (million) |
|-----------------|---|--|-------------------------|
| Base Case       | \$4,387.7                                     | \$4,407.7                              | \$20.00                 |
| +500 MW in GHIJ | \$4,394.6                                     | \$4,406.0                              | \$11.40                 |
| -500 MW in GHIJ | \$4,381.7                                     | \$4,422.2                              | \$40.50                 |

# Lower Bound Conclusions

- The optimization with a lower bound still results in a lower cost when compared to the current methodology
- The optimization still reduces volatility when a lower bound is incorporated

# Cost Curves

- **Phase 1 simple sensitivities only investigated how the magnitude of the cost curves impact the optimization**
- **Phase 2 will perform analysis and sensitivities to:**
  - Investigate the impact of cost curves' shape on optimization
  - Develop a robust methodology for generating the curves
  - Seek to reduce any unnecessary volatility from cost curves

# Next Steps

# Next Steps

- The NYISO will consider input received during today's ICAP Working Group meeting
- Any additional comments sent to [deckels@nyiso.com](mailto:deckels@nyiso.com) will be considered
- The NYISO will return to a future ICAPWG meeting to discuss its progress and adjustments to the plan after considering comments or results

# 2017 Project Development

| <u>Stage</u>                         | <u>Objective</u>   | <u>Specific Topics:</u>  |
|--------------------------------------|--|--|
| <b>Proof of Concept</b>              | Demonstrate alternative methodology in relation to guiding principles ( <i>i.e.</i> , least cost, stability, robust, predictability)                   | Generation +/-<br>Unit net CONE +/-<br>Transmission +/-                      |
| <b>Refine Methodology</b>            | Modify the alternative method to ensure that all aspects have a purpose and are being performed as a result of sound market and engineering principles | Unit net CONE curves<br>Potential Bounds<br>Modeling methodology             |
| <b>Market Simulations</b>            | Simulate realistic market situations to demonstrate performance of methodology   | Changes in resources<br>Topological changes<br>Locality configurations       |
| <b>Defining Process</b>              | Develop a process for the methodology that ensures guiding principles are being achieved over time   | Develop process of method<br>Process timeline<br>Transition methods          |
| <b>Demonstrating Market Benefits</b> | Demonstrate the methodology results in market benefits and resolve any issues that arise from its implementation                                       | LOLE Criterion<br>Consumer impact<br>Multiyear simulation<br>Cost allocation |
| <b>Final Market Design</b>           | Summarize all findings and develop a final market design for implementation  | Develop final market design  |



# Questions?

# The Mission of the New York Independent System Operator, in collaboration with its stakeholders, is to serve the public interest and provide benefits to consumers by:

- Maintaining and enhancing regional reliability
- Operating open, fair and competitive wholesale electricity markets
- Planning the power system for the future
- Providing factual information to policy makers, stakeholders and investors in the power system



[www.nyiso.com](http://www.nyiso.com)

# Appendix

# Changes in Capacity: 500 MW

| Scenario       | Optimized LCR (%) |        |      | Current LCR Methodology (%) |        |      | Optimized Cost (million) | Current LCR Cost (million) |
|----------------|-------------------|--------|------|-----------------------------|--------|------|--------------------------|----------------------------|
|                | Zone J            | Zone K | G-J  | Zone J                      | Zone K | G-J  |                          |                            |
| Base Case      | 77.5              | 107.0  | 91.0 | 81.4                        | 103.2  | 91.3 | \$4,366.4                | \$4,407.7                  |
| +500 MW in G   | 77.7              | 107.7  | 91.1 | 80.2                        | 102.7  | 93.6 | \$4,374.6                | \$4,406.0                  |
| - 500 MW in G  | 77.5              | 107.5  | 90.0 | 83.0                        | 103.8  | 89.6 | \$4,359.8                | \$4,422.2                  |
| +500 MW in J   | 77.9              | 107.0  | 90.4 | 81.9                        | 102.5  | 91.9 | \$4,367.2                | \$4,416.1                  |
| -500 MW in J   | 77.6              | 107.6  | 90.5 | 80.4                        | 104.1  | 90.7 | \$4,366.7                | \$4,394.1                  |
| +500 MW in K   | 78.1              | 106.1  | 90.6 | 80.1                        | 104.5  | 90.5 | \$4,367.6                | \$4,390.2                  |
| -500 MW in K   | 77.6              | 106.1  | 91.8 | 84.4                        | 100.7  | 93.8 | \$4,370.3                | \$4,448.8                  |
| +500 MW in ROS | 77.6              | 106.6  | 90.5 | 81.0                        | 102.9  | 91.3 | \$4,361.6                | \$4,399.4                  |
| -500 MW in ROS | 78.2              | 106.6  | 90.8 | 81.5                        | 103.4  | 91.6 | \$4,374.8                | \$4,414.2                  |

# Changes in Capacity: 1000 MW

| Scenario        | Optimized LCR (%) |        |      | Current LCR Methodology (%) |        |      | Optimized Cost (million) | Current LCR Cost (million) |
|-----------------|-------------------|--------|------|-----------------------------|--------|------|--------------------------|----------------------------|
|                 | Zone J            | Zone K | G-J  | Zone J                      | Zone K | G-J  |                          |                            |
| Base Case       | 77.5              | 107.0  | 91.0 | 81.4                        | 103.2  | 91.3 | \$4,366.4                | \$4,407.7                  |
| +1000 MW in G   | 77.9              | 107.9  | 91.5 | 79.9                        | 102.4  | 96.8 | \$4,383.5                | \$4,430.2                  |
| - 1000 MW in G  | 77.0              | 107.2  | 90.0 | 85.3                        | 104.9  | 88.0 | \$4,350.4                | \$4,443.8                  |
| +1000 MW in J   | 77.9              | 107.0  | 90.4 | 82.5                        | 102.0  | 92.3 | \$4,367.2                | \$4,423.5                  |
| -1000 MW in J   | 77.7              | 106.0  | 91.6 | 79.2                        | 106.2  | 89.8 | \$4,368.5                | \$4,379.2                  |
| +1000 MW in K   | 77.7              | 106.0  | 91.5 | 79.7                        | 105.0  | 90.3 | \$4,368.2                | \$4,385.3                  |
| +1000 MW in ROS | 77.4              | 107.1  | 90.2 | 80.9                        | 102.7  | 91.1 | \$4,357.6                | \$4,393.4                  |
| -1000 MW in ROS | 78.1              | 107.7  | 91.1 | 82.0                        | 103.8  | 91.8 | \$4,383.0                | \$4,426.3                  |

# Changes in Net CONE

| Scenario        | Optimized LCR (%) |        |      | Current LCR Methodology (%) |        |      | Optimized Cost (million) | Current LCR Cost (million) |
|-----------------|-------------------|--------|------|-----------------------------|--------|------|--------------------------|----------------------------|
|                 | Zone J            | Zone K | G-J  | Zone J                      | Zone K | G-J  |                          |                            |
| Base Case       | 77.5              | 107.0  | 91.0 | 81.5                        | 103.5  | 91.5 | \$4,366.4                | \$4,413.7                  |
| +\$50 GHIJ      | 78.1              | 108.3  | 89.5 | 81.5                        | 103.5  | 91.5 | \$5,090.3                | \$5,148.5                  |
| -\$50 GHIJ      | 77.0              | 106.2  | 94.8 | 81.5                        | 103.5  | 91.5 | \$4,079.8                | \$4,154.4                  |
| +\$50 Zone J    | 77.4              | 108.1  | 90.6 | 81.5                        | 103.5  | 91.5 | \$4,818.7                | \$4,889.3                  |
| -\$50 Zone J    | 78.1              | 106.6  | 90.2 | 81.5                        | 103.5  | 91.5 | \$3,911.8                | \$3,938.1                  |
| +\$50 Zone K    | 77.6              | 105.9  | 91.9 | 81.5                        | 103.5  | 91.5 | \$5,109.2                | \$5,170.1                  |
| -\$50 Zone K    | 77.3              | 109.1  | 90.3 | 81.5                        | 103.5  | 91.5 | \$4,073.7                | \$4,132.8                  |
| +\$50 NYCA      | 76.8              | 107.2  | 94.0 | 81.5                        | 103.5  | 91.5 | \$5,747.2                | \$5,831.1                  |
| -\$50 NYCA      | 78.1              | 106.8  | 90.2 | 81.5                        | 103.5  | 91.5 | \$3,424.9                | \$3,471.9                  |
| +\$50 All Zones | 77.5              | 107.0  | 91.0 | 81.5                        | 103.5  | 91.5 | \$6,323.9                | \$6,371.2                  |

# Changes in Transmission

| Scenario          | Optimized LCR (%) |        |      | Current LCR Methodology (%) |        |      | Optimized Cost (million) | Current LCR Cost (million) |
|-------------------|-------------------|--------|------|-----------------------------|--------|------|--------------------------|----------------------------|
|                   | Zone J            | Zone K | G-J  | Zone J                      | Zone K | G-J  |                          |                            |
| Base Case         | 77.5              | 107.0  | 91.0 | 81.4                        | 103.2  | 91.3 | \$4,366.4                | \$4,413.7                  |
| UPNY-SENY+500 MW  | 77.7              | 107.2  | 87.7 | 80.0                        | 102.5  | 90.5 | \$4,342.1                | \$4,369.9                  |
| UPNY-SENY+1000 MW | 78.1              | 107.4  | 84.6 | 79.7                        | 102.3  | 90.3 | \$4,325.6                | \$4,362.4                  |